

**Z E P**  
Technology Platform  
Zero Emission Fossil Fuel Power Plants

## **Zero Emission Fossil Fuel Power Plants ZEP European Technology Platform, Perspective of an Energy Supply Company**

**Heinz Bergmann**  
RWE Power, Germany

**Geneva, 29 November 2006**  
**UNECE Committee on Sustainable Energy: Coal Session**



## **Table of Contents**

---

- Challenge of climate change
- Future role of fossil fuels
- Current efforts to increase power plant efficiency
- Cost comparison of main CCS-technologies
- Pilot and demo projects of German utilities
- CO<sub>2</sub> storage potential in Germany
- Expected support of EC/politics
- Summary




## Challenge of Climate Change

(Source: Herve le Treut/LMD, CNRS, Sept. 2006)

The composition of the atmosphere has changed more significantly in the past century than in the previous two thousand years.

Anthropogenic changes in the composition of the atmosphere modify the equilibrium of a complex system.

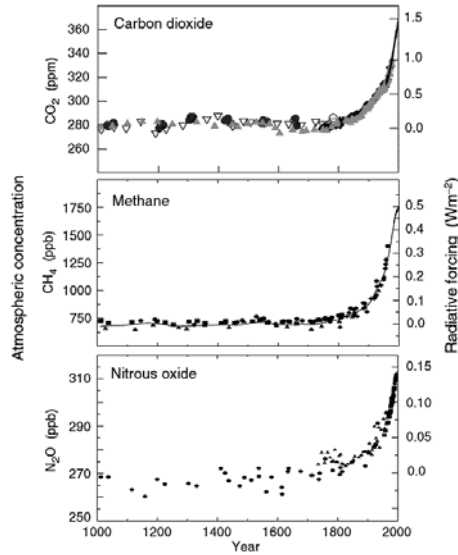

November29, 2006


Heinz Bergmann, RWE Power

3



## Challenge of Climate Change

(Source: Herve le Treut/LMD, CNRS, Sept. 2006)

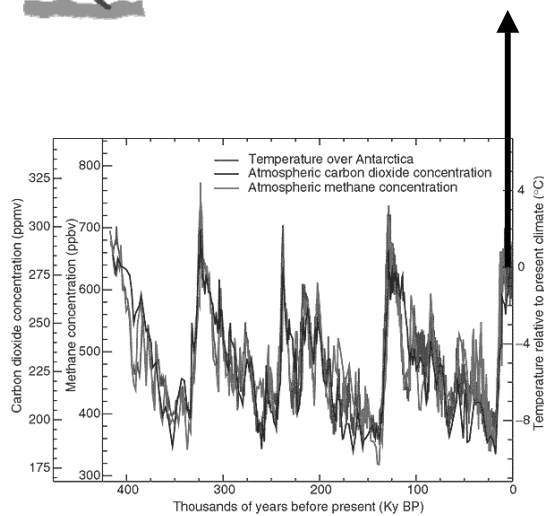

Considered on a geological time scale, current changes are happening at a very fast pace.

A Global solution with long term commitments is needed.

ZEP takes an active role to accelerate governments and global institutions towards practical solutions.

November29, 2006

Heinz Bergmann, RWE Power


4



## Future Role of Fossil Fuels in the Global Energy Mix

(Source: DOE/EIA, International Energy Outlook 2006, Washington 2006)

Global net power generation  
in billion MWh

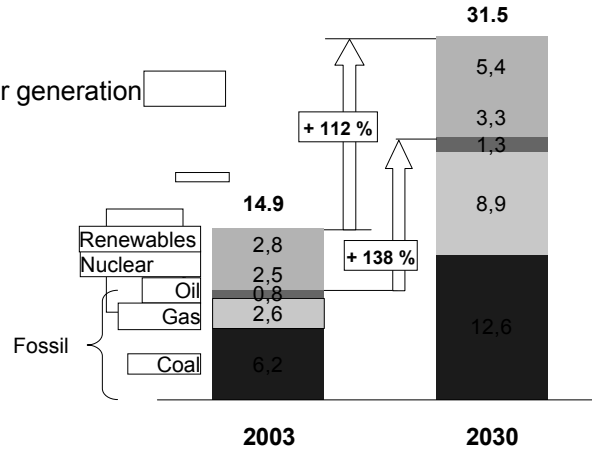

► Coal will remain vital to energy supply in the future.

November 29, 2006


Heinz Bergmann, RWE Power

5



## Global CO<sub>2</sub> Emissions

- IEA Scenarios 2003-2050 (Source: IEA, June 2006)

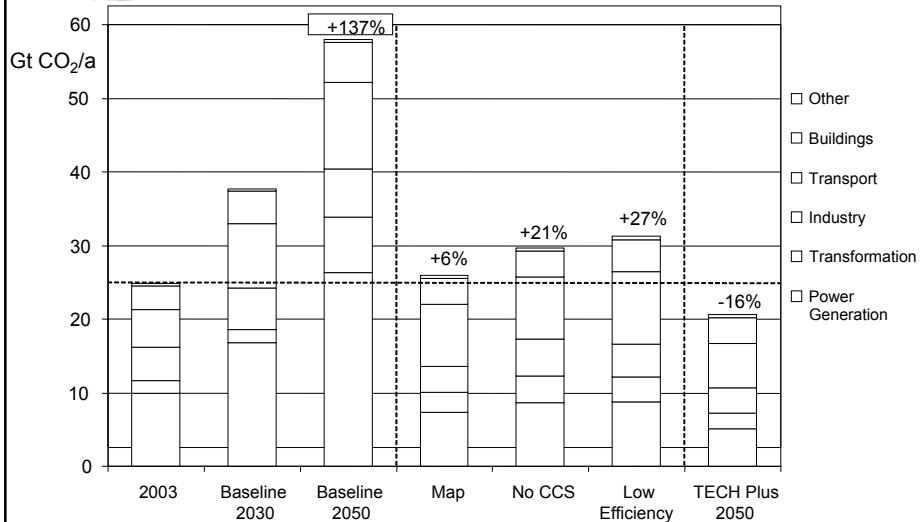

November 29, 2006


ACT Scenarios 2050  
Heinz Bergmann, RWE Power

6



## Global Electricity Generation by Fuel - IEA Scenarios 2003-2050

(Source: IEA, June 2006)

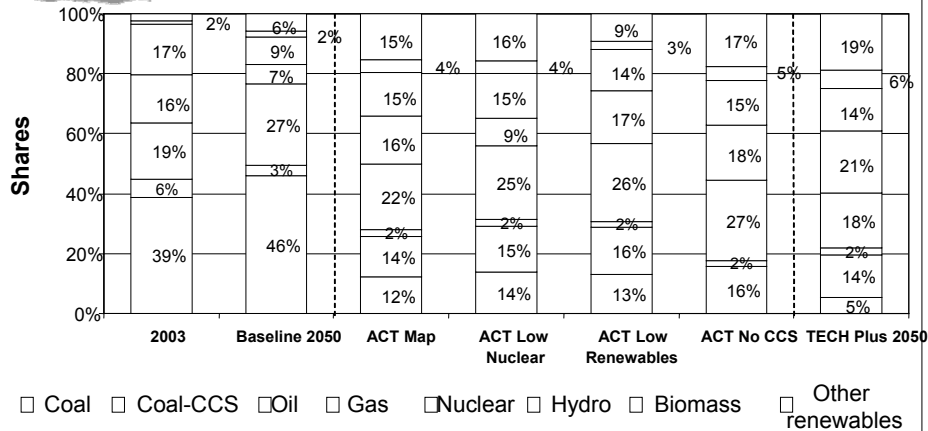

**Important role for CCS and strong growth in the shares for renewables and nuclear.**

November29, 2006

Heinz Bergmann, RWE Power

7



## A Three Phase Argumentation

- Reducing emissions and increasing efficiency in ecologically and economically optimised steps
  - Modernisation of existing plants: SO<sub>2</sub>, NO<sub>x</sub>, dust, retrofit
  - Construction of new state-of-the-art power plants
- Development of high-efficiency power stations with the aim to minimise consumption of resources and reduce specific emissions, particularly those of CO<sub>2</sub>
- New Technologies for CO<sub>2</sub> capture and storage

November29, 2006

Heinz Bergmann, RWE Power

8



## Current Efforts to Increase Power Plant Efficiency

percentage points

- COMTES 700: material and component test for 700 °C technology (joint project of VGB, generators, equipment suppliers and EU) → + 4 %  
(compared to 600/620 °C, 275 bar live steam)
- Fluidised-bed drying process for lignite (RWE Power) → + 4 %  
(43 → 47 % - net)
- CCGT-Project Irsching to increase net efficiency up to 60 % (Siemens, E.ON) → + 1,5-2 %  
(58 → 60 % - net)
- Efficiency improvements by replacement of existing steam turbines by new turbines with 3D-designed blades (retrofitting) → Depending on individual case
- Further increasing of net efficiency of PC-boilers by development of materials for live steam parameters of 750 °C and more (COORETEC, BMWi) → + 5 %  
(→ 55% - net)

**Objectives:** Efficiencies of more than 50 % for steam power plants and above 60 % for gas turbine plants

November29, 2006

Heinz Bergmann, RWE Power


9



## EC-Projects on the Way to 50% Coal Fired Power Plant (Source: E.ON)


### COMTES700

- EC-funded project managed by VGB to test nickel-based components (joint project of generators and equipment suppliers)
- Pilot plant in Scholven with 40 MW<sub>th</sub>
- Operation 2005 - 2009

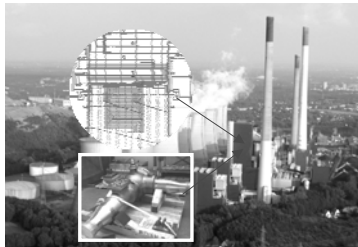

### NRWPP700

- Pre-Engineering study from 09/2006-07/2008 for a 700°C demonstration plant with >400 MW
- EC-funded project managed by VGB
- Basic and detail design for boiler, turbine and connecting pipework

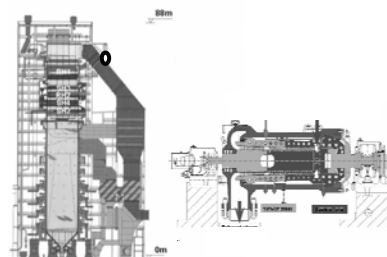

November29, 2006

Heinz Bergmann, RWE Power

10




## Efficiency enhancement as a fundamental way to CO<sub>2</sub> reduction


(Source: RWE)

**Development goal: dry lignite-fired PP**  
 Offsets lignite's drawbacks compared to hard coal; application from 2014  
 $\eta$ : + 4 % points  $\rightarrow \eta > 47\%$

WTA technology permits drying heat recovery through recondensation of the evaporated water.

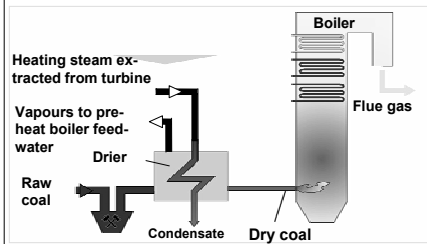

**Development goal: 700°C PP for L/H/C**  
 Novel materials permit steam parameters of 350 bar/700 °C; application from 2018  
 $\eta$ : + 4 % points  $\rightarrow \eta > 50\%$

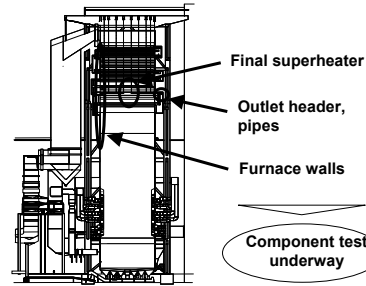

Together, both measures bring up the efficiency of lignite-fired power plants to > 50 %

November29, 2006

Heinz Bergmann, RWE Power

11




## Main Technology Options for CO<sub>2</sub> Capture from Power Plants

Three technologies seem capable to fulfil the primary target to 2020


- All largely contain known technology and components
- All need optimization, scale up and process integration
- Power process efficiency increase is always a supporting activity

### Post-combustion CO<sub>2</sub> capture (steam power plants)

#### Conventional power plant with CO<sub>2</sub> scrubber




#### Oxy-fuel process



### Pre-combustion CO<sub>2</sub> capture (IGCC power plants)

#### IGCC process



□ Development demand


November29, 2006

Heinz Bergmann, RWE Power

12



## Power Generation Cost for Large Scale Power Plants in 2020 (Source: ZEP – WG1)

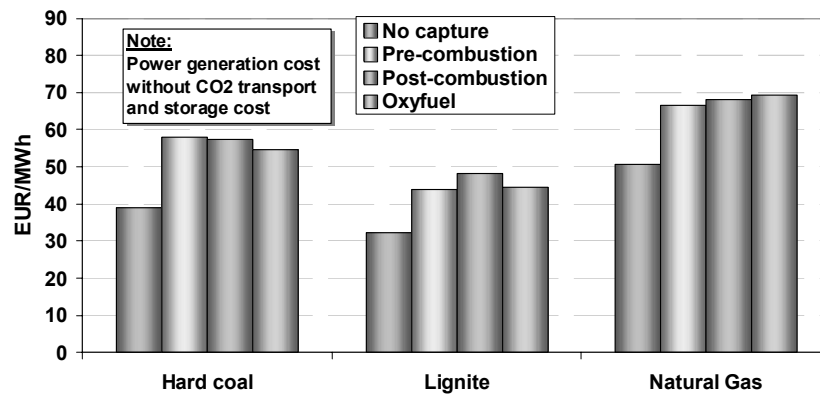


November29, 2006

Heinz Bergmann, RWE Power

13



## Avoidance Cost for Large Scale Power Plants in 2020 (Source: ETP ZEP – WG1)

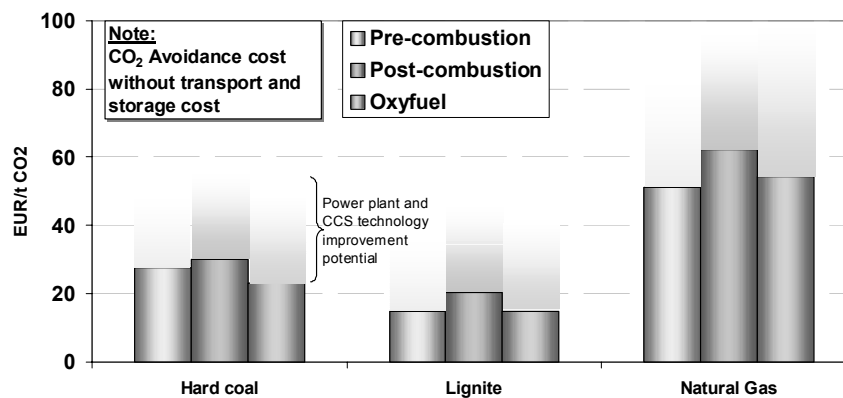


November29, 2006

Heinz Bergmann, RWE Power

14



## Pilot and Demo Projects



### Post-Combustion




- Shell/Statoil, NO, 860 MW, NG-CC, EOR (Draugen, Heidrun), 2010
- RWE, coal, retrofit, Tilbury/UK, 2016

### Pre-Combustion

- BP/S&SE/GE, UK, 350 MW, NG-CC, EOR (Miller), 2010
- RWE, D, 450 MW, coal, IGCC, 2014
- E.ON/UK, Killingholme, 450 MW, 2011
- GE, PL, 900 MW, coal, IGCC, 2011

### Oxy-fuel

- Vattenfall, Schwarze Pumpe/D, 30 MW<sub>th</sub>, coal, 2008
- Total, Lacq/F, 30 MW, liquid fuel, retrofit, 2008



November29, 2006

Heinz Bergmann, RWE Power

15



## Share of Fossil Fuels in German Power Plant Capacity 31.12.2005

GW	RWE	E.ON	Vattenfall
Hard coal	9,6	7,5	0,5
Lignite	10,1	1,3	7,4
Gas	3,7	3,8	1,0
Oil	-	1,1	-
<b>Fossil Fuel</b>	<b>23,4</b>	<b>13,7</b>	<b>8,9</b>
Nuclear	5,5	8,5	1,5
Other	2,9	3,4	2,9
<b>Total</b>	<b>31,8</b>	<b>25,6</b>	<b>13,3</b>



November29, 2006

Heinz Bergmann, RWE Power


16





## The Vattenfall Project of a CO<sub>2</sub>-free Oxyfuel Pilot Plant

(Source: Vattenfall)

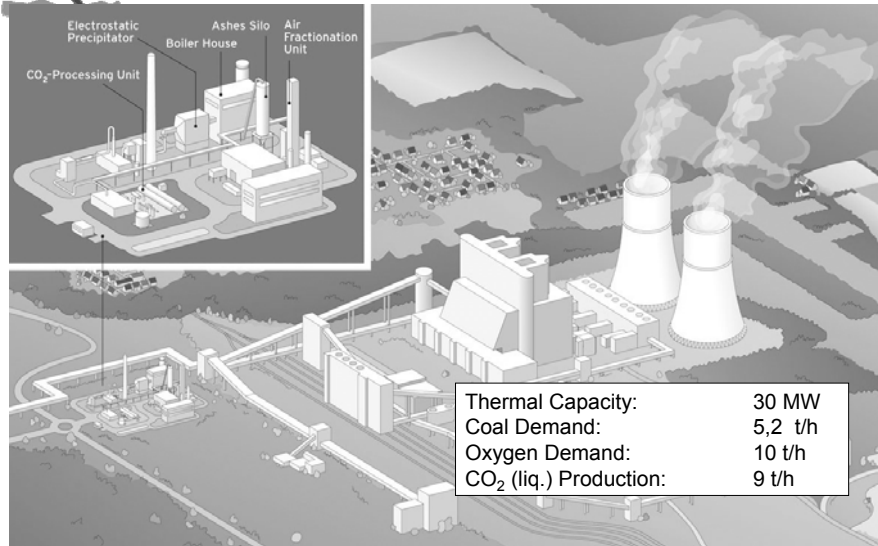

November29, 2006

Heinz Bergmann, RWE Power

19



## Advantages of oxyfuel technology

(Source: Vattenfall)

- Power plant process with high efficiency potential
- High CO<sub>2</sub>-separation potential
- Comparable to conventional steam power plant process
- Investment and operation cost good assessable based on conventional power plant technology



November29, 2006

Heinz Bergmann, RWE Power

20



## Development of the oxyfuel power plant (Source: Vattenfall)

Incineration tests 0,05 MW <sub>th</sub>	Test facility 0,5 MW <sub>th</sub>	Pilot plant 30 MW <sub>th</sub>	Demo plant 300- 600 MW	Commercial plant 1.000 MW
Basics of incineration behaviour  2004 / 2005	Basics of flue gas recirculation  • 2005 / 2006	Test of complete technology chain  • 2008	Realisation of CO <sub>2</sub> storage / proof of economics  • 2015	Competitive power plant  • 2020
• TU Dresden ADECOS (Joint project)	• BTU Cottbus CEBRA (Joint Project)	• KW Schw. Pumpe Vattenfall	...	...


November29, 2006

Heinz Bergmann, RWE Power

21



## The RWE Project of a Zero-CO<sub>2</sub> 450 MW Power Plant with CO<sub>2</sub> Storage (IGCC-CCS) (Source: RWE)

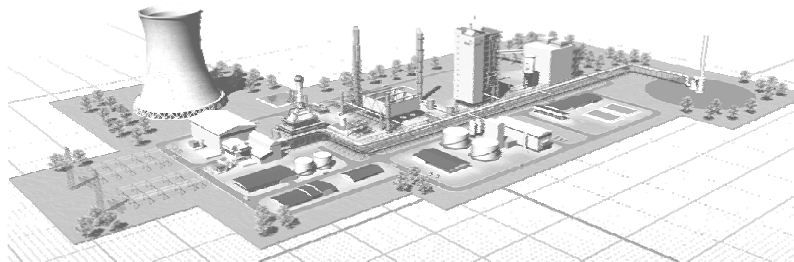

- Basic technology: IGCC
- El. capacity: 450 MW<sub>gross</sub> / 360 MW<sub>net</sub>
- Net efficiency: 40%
- CO<sub>2</sub> storage: 2.3 mill. t/a in depleted gas reservoir or saline aquifer
- Commissioning: 2014
- RWE budget: approx. € 1 billion

November29, 2006

Heinz Bergmann, RWE Power


22



## IGCC Offers Excellent Product Flexibility

Fuel flexibility

Product flexibility

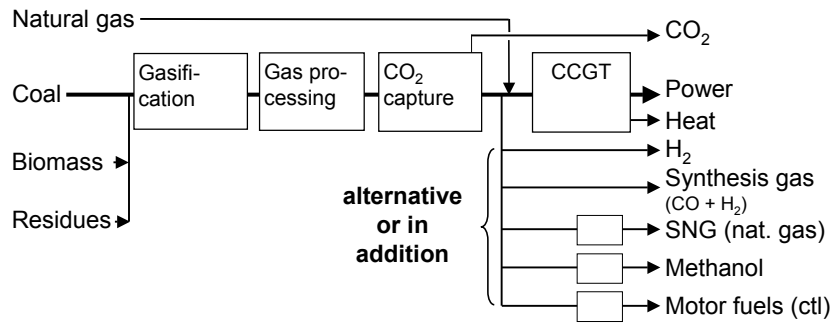

November29, 2006


Heinz Bergmann, RWE Power

23



## Advantages of IGCC technology

(Source: RWE)

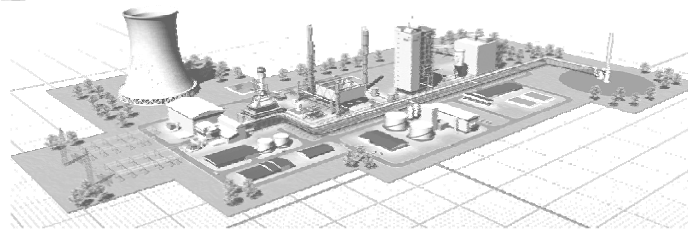

- Fuel and product flexibility
- Only technology that can already be implemented on a large scale today
- Components tested in large scale, own RWE know-how
- Power plant process with highest efficiency potential, efficient operation also without CO<sub>2</sub> capture

November29, 2006

Heinz Bergmann, RWE Power

24





## Expected Support of EC/Politics (1)

---

- Clear commitment to coal as important part of the future energy mix
- Clear commitment to CCS as instrument for CO<sub>2</sub> mitigation to stop climate change
- Support of efficiency increase to minimise consumption of resources and as pre-requisite of ZEP
- Create legal framework for geological storage of CO<sub>2</sub>:  
amendment of EU waste and water framework directive and  
amendment of national mining law

November29, 2006

Heinz Bergmann, RWE Power

27



## Expected Support of EC/Politics (2)

---

- Support and active cooperation in public relations to get the acceptance for ZEP
- Sufficient financial support of the ZEP recommendations within SRA and SDD to allow for the necessary R&D and to set out for 10 - 12 demo projects
- No preference for renewable energies within the European FP7
- Close collaboration in ETP-ZEP and in continuation of German COORETEC initiative

November29, 2006

Heinz Bergmann, RWE Power


28



## Towards Zero CO<sub>2</sub> Power Generation

### CO<sub>2</sub> capture

- post-combustion at conventional plants
- pre-combustion at gasification plants
- oxy-fuel combustion



### CO<sub>2</sub> storage

- deep saline aquifers
- depleted oil and gas fields
- unmineable coal seams
- mineralisation

Some technologies are well-proven, others need significant R&D. All require demonstration with monitoring & verification of storage sites. An information campaign for public acceptance is needed.

**Research in both areas is necessary with the same effort.  
There will be no acceptance for a zero emission power station without CO<sub>2</sub> storage possibilities.**

November29, 2006

Heinz Bergmann, RWE Power

29



## Summary

- Coal will remain its worldwide importance for electricity generation.
- Coal has to be used even more efficient and environmental friendly.
- Precondition is the large scale test of efficiency increasing technologies like integrated coal drying and raised steam parameters as well as CO<sub>2</sub> capture and storage.
- The necessary time-frame is about 10 to 15 years. Joint development projects make it easier to be successful.
- The joint generators activities and the cooperation within the ZEP technology platform confirm these considerations
- CO<sub>2</sub> capture and storage is a promising option to secure the future of power generation based on fossil fuels. It doesn't reduce, however, the necessity of CO<sub>2</sub> avoidance through further efficiency increases
- The technical feasibility of ZEP technologies is beyond dispute.
- The economic efficiency will depend on the political frame-conditions.

November29, 2006

Heinz Bergmann, RWE Power

30



---

**Thank you for your attention**