Mapping of Existing Technologies to Enhance Energy Efficiency in Buildings in the UNECE Region

Kankana Dubey, Andrey Dodonov

(draft as of 14.01.2019)

GENEVA, 2018

Draft

Table of Contents

List of Figures 4

List of Tables 4

Acronyms and Abbreviations 5

Signs and Measures 5

Executive Summary 6

Introduction 10

CHAPTER 1 - Objective, Scope, Methodology, and Limitations 14

CHAPTER 2 – Energy Efficient Technologies in Buildings in the UNECE Region 17

2.1. Building Envelope: Insulation and Glazing 18

2.1.a Insulation of building envelope, airtightness, thermal bridging 18

2.1.b Installation of modern windows with higher thermal characteristics 21

2.2. Heating, domestic hot water supply 22

2.2.a Improvement of decentralized heating supply system 22

2.2.b Improvement of centralized heating supply system 27

2.2.c System performance optimization measures 28

2.3 Air conditioning, Ventilation and Cooling 31

2.3a Application of Frequency converter Drives for the for electric motors of pumps and fans 31

2.3.b Application of heat recovery for centralized mechanical inlet and outlet ventilation systems 32

2.3.c Application of cooling system with variable flow 33

2.4 Energy efficient appliances (EE labeling) 33

2.5 Modernization of existing lighting system of the building 34

CHAPTER 3 - Current Deployment of Energy Efficient Technologies - Data Analysis and Review 36

Subregions A, B, and D 36

Building Envelope: Insulation and Glazing 36

Space Heating, Air Conditioning, Water Heating and Cooling 39

Air Conditioning, Ventilation, and Cooling 40

Appliances 42

Lighting 43

Smart Systems and Solutions 45

Subregions C, E and F 47

Building envelope: insulation and glazing 47

Space Heating, Air Conditioning, Water Heating and Cooling 49

Improvement of Decentralized Heating Source 49

Common Measures and Improvement of Centralized Heating System 50

Ventilation, Air Conditioning and Cooling 51

Appliances 52

Draft

Lighting.....53
Smart Systems and Solutions 54
Future scope of study.....60
References 61

Draft

List of Figures

FIGURE 1.	Technical solutions for insulation	19
FIGURE 2.	Insulation materials applied in the UNECE region	20
FIGURE 3.	Energy efficient window profiles	21
FIGURE 4.	Examples of modern gas-fired boilers	23
FIGURE 5.	Examples of solar heating systems	25
FIGURE 6.	Types of heat pumps	26
FIGURE 7.	Diagram of centralized district heating system	27
FIGURE 8.	Individual automatic heat point with weather compensation control	28
FIGURE 9.	Pipe insulation and insulated distribution pipes of HVAC systems	29
FIGURE 10.	Thermostatic radiator control elements	29
FIGURE 11.	Balancing valves for HVAC systems	30
FIGURE 12.	Frequency converters	32
FIGURE 13.	Heat recovery unit for mechanical inlet and outlet ventilation	33
FIGURE 14.	Energy efficiency labeling	34
FIGURE 15.	LED lamps	35
FIGURE 16.	New construction building envelope technology mix in subregion A	37
FIGURE 17.	Retrofits building envelope technology mix in subregion A.	37
FIGURE 18.	New construction building envelope technology mix in subregion B.	37
FIGURE 19.	Retrofits building envelope technology mix in subregion B.	38
FIGURE 20.	New construction space heating technology mix in subregion A.	39
FIGURE 21.	New construction space heating technology mix in subregion B.	40
FIGURE 22.	New construction ventilation, air conditioning, and cooling technology mix in subregion A.	41
FIGURE 23.	New construction ventilation, air conditioning, and cooling technology mix in subregion B	41
FIGURE 24.	New construction Lighting technology mix in subregion A.	44
FIGURE 25.	New construction Lighting technology mix in subregion B.	44
FIGURE 26.	Technology mix of existing buildings envelope modernization in subregion C, E, and F.	47
FIGURE 27.	Technology mix of improvements of decentralized heating sources for existing buildings in subregions C, E, and F.	49
FIGURE 28.	Common measures for heating system for new construction technology mix in	51
FIGURE 29.	Ventilation, air conditioning and cooling technologies mix for existing buildings in subregion C, E, and F.	52
FIGURE 30.	Application of lighting technologies in subregions C, E, and F, for new construction.	54

List of Tables

TABLE 1.	Impact Score Assessment Criteria	15
TABLE 2.	Types of solar collectors.	24
TABLE 3	Assessment of market saturation for building envelope materials	39
TABLE 4	Assessment of market saturation of heating, cooling and other EE technologies	42

Draft

Acronyms and Abbreviations

ASHRAE	American Society of Heating, Refrigerating and Air – conditioning Engineers
CFL	Compact Fluorescent Lamps
DHW	Domestic Hot Water
EPBD	Energy Performance of Buildings Directive
EPC	Energy Performance Certification
EMIS	Energy Management Information System
ENMS	Energy Management System
ESCO	Energy Service Company
EU	European Union
HVAC	Heating, ventilation, and air conditioning
ISO	International Organization for Standardization
LED	Light-Emitting diode (lamps)
NGOs	Non-governmental organizations
SDGs	Sustainable Development Goals
UNDP	United Nations Development Program
UNECE	United Nations Economic Commission for Europe

Signs and Measures

kWh	kilowatt hour
m^2	square metre
W/mK	watts per metre Kelvin
W/m^2K	watts per square metre Kelvin
kWh/m^2yr =kWh/m2a	kilowatt hour per square metre per year

Draft

Executive Summary

One of the most important goals of public policy to stimulate the transition to a sustainable energy system is to improve energy efficiency, with consideration to flexibility and adaptability, and to accelerate progress towards achieving the objective of sustainable development. Indeed, according to the UNECE, "improving energy efficiency is one of the most cost-effective options for meeting growing energy demand in most countries. It contributes to energy security, a better environment, improved quality of life, and economic well-being". While it is generally recognized that significant progress is being made, there is still substantial potential for improving energy efficiency worldwide.

Across all countries in the United Nations Economic Commission for Europe (UNECE) region, buildings account for approximately one third of energy consumption, and 40 percent of CO_2 emissions (UNECE 2018). The buildings sector thus presents a unique opportunity to substantially improve energy efficiency – both via retrofitting existing buildings and requiring higher energy efficiencies on newly-constructed buildings. National public policy includes a variety of mechanisms which are meant to encourage increasing building energy efficiency. These include mandatory standards, cash and tax incentives, and consumer information programs.

In 2017, the UN Committee on Housing and Land Management (CHLM) and the Committee on Sustainable Energy (CSE) commissioned a comparative study on building standards in the UNECE region, entitled "Mapping of Existing Energy Efficiency Standards and Technologies in Buildings in the UNECE Region". The current report, "Mapping of Energy Efficiency Standards in Buildings" follows up on this earlier study by analyzing the actual prevalence of specific types of energy-efficient technologies in the buildings sector in the UNECE region, along with the levels and types of public policy interventions supporting their implementations. The study objectives are to evaluate the adaptation of these technologies by UNECE member States and identify and analyse gaps between the existing energy efficient technologies in buildings and their application and adaptation, with assessments undertaken at national levels. The study aims to highlight the difference in the use of technologies between countries through gap analysis, to determine if any correlation exists between the strictness and enforcement of existing standards and the level of applied technologies. The data for this study has been gathered mainly through desktop research of both internet and print media.

In continuation with the previous study, the UNECE member States are categorized into subregions, detailed in the methodology section of Chapter 1. The analysis is based on empirical data, analysed on a 3-point scale (Low, Medium, High) for implementation of the building energy efficiency technologies which are identified in Chapter 2. For tabulation and analysis, the technologies were aggregated into five high-level categories - "Building Envelope and Glazing", "Heating of Domestic Hot Water Supply", "Air Conditioning, Ventilation, and Cooling", "Appliances" and "Lighting" - and separately assessed by building type. The tabulated data, along with country-specific narratives, is documented in the annexes at the end of this report.

The data presents some interesting findings for the UNECE region which can assist stakeholders in a variety of roles: policy makers to understand the potential of adopting energy efficiency technologies, private sector participants to comprehend the market potential, and governmental entities (municipal and utility providers) to tap into the ancillary benefits of promoting building energy efficiency.

Draft

Denmark has extensively encouraged the installation of new electrical boilers for building heating during both renovations of existing buildings and construction of new buildings. In Finland, however, oil-burning boilers are more prevalent, though the Government has various measures in place to encourage switching from oil-heating systems to more efficient alternatives.

The data suggests that some aspects and types of energy efficiency technologies are very consistently required and implemented in the buildings sector across the UNECE member States. For example, efficient building envelope insulation (including windows) is used in all countries, and many member States have made good progress – at least for buildings owned/occupied by the public sector. Another example of consistent application is public policy to phase out incandescent bulbs in favor of more efficient lighting technology. On the other hand, the analysis has found much wider disparities in the prevalence of energy efficient decentralized space heating technologies.

The broad findings throughout the UNECE subregions are:

1. Analysis based on the data collected shows overall positive trends in energy efficiency in the buildings sector in all the regions. Countries in Eastern European, Central Asia, Russian Federation and South East Europe, which traditionally have low internal energy prices, have significantly increased mandatory energy efficiency requirements, especially for the newly constructed buildings. Having said that, energy efficiency in the buildings sector is improving only incrementally and in disjoint fragments. This is particularly surprising, given that recent advances in technology design have yielded remarkable advancements in efficiency and this trend is expected to continue.
2. This study highlights three types of public policy tools, which support energy efficiency improvements in buildings, as successful practice: legal regulations (such as building standards), financial incentives (rebates, reduced-rate debt, tax deductions), and information awareness programmes for various types of energy efficient technologies.
3. Positive correlations between existence, scope, and stringency of building standards, and application of energy efficient technologies and their diverse mix have been identified.
4. Substantial gaps between what is available in the market and what is used makes it clear that effective implementation, rather than just technical advancement, is key to increasing energy efficiency.
5. EU countries show increased adoption of high energy efficiency boilers, along with shifts to cleaner fuel sources. However, strong concerns remain regarding the use of coal for residential space heating.
6. With the implementation of labelling and eco-design regulations, the uptake of energy efficient appliances is on an upward trend.
7. Most countries in the UNECE region have banned, or are phasing out, incandescent light bulbs in favour of CFL and LED technologies. Lighting sensors and controls are being implemented less frequently.
8. Energy performance certificates have accelerated retrofitting of existing buildings but much needs to be done.
9. In addition to the numerous environmental benefits associated with decreased energy consumption and increased generation of renewable electricity, many of the technologies discussed in this report offer additional non-energy related social benefits.

Draft

Recommendations based on the mapping and gap analysis are summarized here. These focus on priority actions countries can take to increase the uptake of technologies to enhance energy efficiency in buildings. The recommendations cover multiple perspectives, such as knowledge, technical, regulatory, financial, institutional, technology adaptation, capacity development, and private sector involvement.

1. Policy and legislation

Recommendation A: *Governments need to provide good policy, strong institutions, and efficient public services to ensure the private sector can thrive; they must also commit to develop and sustain the institutions that implement, oversee, and regulate these policies.*

Recommendation B: *Governmental research and development programs should be designed to advance technologies which are too risky for the private sector*.

Recommendation C: *More specific requirements to better define cooling degree-days should be included in energy efficiency standards in buildings.*

2. Role of public and private sector; new market opportunities

Recommendation D: *Governments should undertake initiatives to raise the bar for developing energy efficient technologies in buildings locally, which can create new international markets.*

3. Connect building energy efficiency with INDC targets; reduce fossil fuel use in space heating

Recommendation E: *Governments should explicitly connect building energy efficiency measures to INDC targets to further encourage improvement*.

Recommendation F: *Governments of countries in which coal is still used for residential heating, and coal is the lowest cost fuel, should promote the use of other fuels to drive the adoption of cleaner technologies*.

4. Informational awareness for multiple social benefits of energy performance certification

Recommendation G: *Local governments should publish city-level data demonstrating both decreased energy costs and higher income associated with various levels of energy performance certification to promote building energy efficiency investments*.

5. Technological adaptation through effective promotion and awareness campaigns

Recommendation H: *Effective promotion and awareness campaigns are essential to encourage consumers to purchase appliances labelled with high energy efficiency ratings.*

6. Key focus on building retrofits

Recommendation I: *Governments should promote the creation of datasets and tools which guide analysis of, and demonstrate, the financial benefits of increasing energy efficiency through retrofitting existing buildings. Specifically, this should include the use of simulation software tools for building energy performance during the design phase of both new building construction and post through major building retrofits.*

Recommendation J: *Governments should develop and promote programs to encourage complete retrofit of depleted and condemned residences involving private real estate investors or developers*.

7. Coordination between federal and regional governments to reassess development and implementation of building codes

Recommendation K: *Federal and regional governments need to coordinate and work together to design the policies and building codes which can be adopted either nationally or regionally.*

Draft

8. Investment and finance

Recommendation L: *Governments should develop and promote multiple financial mechanisms to increase the uptake of energy efficiency projects across the buildings sector: individual, public and commercial.*

9. Capacity building to promote building retrofits

Recommendation M: *Courses and programs focused on renovation of existing buildings should be made part of standard civil engineering educational and training curricula*.

Recommendation N: *Financial institutions should be empowered to understand profitability of energy efficiency investments*.

10. Expanded use of Energy Performance Certificates

Recommendation O: *Governments could create tiered energy tariffs linked to EPC rating.*

Recommendation P: *Incentives for implementing energy efficiency technologies could be linked to EPC rating*.

Draft

Introduction

According to the report "Energy for Sustainable Development in the UNECE Region" released in 2017 by the United Nations Economic Commission for Europe (UNECE, 2017a), one of the most important goals of public policy to stimulate the transition to a sustainable energy system is to improve energy efficiency expeditiously. The report states, "Improving energy efficiency is one of the most cost-effective options for meeting growing energy demand in most countries. It contributes to energy security, a better environment, improved quality of life, and economic well-being" (UNECE, 2017a, p. 10). The UN's Sustainable Development Goals target 7.3 (SDG7.3) is to "double the global rate of improvement in energy efficiency by 2030" (UNECE, 2017a, p. 1). There is significant potential worldwide for improving energy efficiency, and it is widely recognized that significant progress is indeed being made. According to the Enerdata Global Energy Statistical Yearbook 2016, global energy intensity[1] improved by 1.8% in 2016 and 1.2% in 2017. However, there are still significant barriers hindering this progress

Buildings play a pivotal role and are integral to all sectors of the economy such as industry and manufacturing, and the services sector (tourism, financial services, public buildings, schools, universities, hospitals). The buildings sector has the largest potential for cost-effective improvement in energy efficiency and emissions reductions. Additionally, focusing on the buildings sector brings significant social co-benefits, such as:

- increasing energy security
- expanding entrepreneurial opportunities
- reducing energy poverty
- increasing access to energy services
- improving air quality (both indoor & outdoor), with positive impact on occupant's health
- increasing comfort and living standards
- reduction in carbon emission

It can be said that highly efficient buildings are the foundation of healthy, prosperous, secure, and sustainable communities.

Along with the integral impact and strong potential for increased energy efficiency in the buildings sector, there is a second reason to focus on energy efficiency in buildings. The buildings sector is already quite regulated, which enhances dissemination of energy efficiency requirements, further driving progress.

Many countries have set up official national energy efficiency laws or programmes with quantified energy efficiency targets. These programmes can have a substantial impact on the durability and effective coordination of public policy in favour of energy efficiency but require sufficient political consensus for practical implementation.

The purpose of this study is to analyse the gaps between existing energy efficiency technologies in the buildings sector and their application and adaptation in the UNECE region. This report aims to highlight the gap between the strictness and enforcement of existing standards and the level of application of energy efficiency technologies for heating, cooling, ventilation, and lighting in the built environment.

The analysis discussed in this report (see Chapter 3) is based on empirical data, presenting some interesting findings for countries in the UNECE region, which can assist stakeholders in a variety of roles: policy makers to understand the potential of adopting energy efficiency technologies, private sector participants to comprehend the market potential, and governmental entities (municipal and utility providers) to tap into the ancillary benefits of promoting building energy efficiency. The data upon which the gap analysis is based is presented in the annexes, along with country-specific narratives.

[1] Energy intensity is defined as total energy consumption divided by gross world product.

Draft

Three major types of factors affect building energy efficiency during its use – condition and design of the building structure and envelope, performance of major equipment (boilers, AC units, lighting, *etc.*), and occupant behavior (temperature, timing and use of appliances and lights). Optimizing the energy efficiency of the components of these factors, with respect to occupant comfort and safety, requires complex building energy systems to monitor and control the internal environment. However, a significant number of companies in the UNECE region don't currently implement such standardized energy management systems (UNECE, 2017b, p. 27).

Given the importance and urgency of improving energy efficiency globally, the building sectors' high potential for cost-effective improvement in energy efficiency and emissions reductions, and well-documented myriad social co-benefits related to energy-efficient buildings, the existence of substantial gaps is unexpected. Indeed, multiple barriers make it difficult to transform the vast potential of energy savings in the buildings sector into a reality. Some of these barriers are general (that is, they apply to all energy efficiency projects in all sectors), while others are specific to the buildings sector. General barriers to improving energy efficiency include:

- lack of technology
- limited financing
- insufficient awareness and expertise of financiers
- un-adapted or missing regulations
- high costs of reliable information
- greater weight given to upfront costs compared to recurring costs
- lack of knowledge by building owners and/or design teams

It is found that most countries lack governmental agencies with a clear mandate and adequate capacity to design and implement policies in favour of building energy efficiency. One significant barrier specific to the buildings sector is structural complexity; a holistic systems perspective, which leads to more thorough optimization of design and operation and hence improved energy efficiency, requires more breadth and depth of expertise that what is commonly found (UNDP, 2009).

A variety of public policies designed to improve energy efficiency in the buildings sector have been implemented throughout the UNECE region, with varying degrees of success. In the European Union (EU) countries, much attention has been given over the past decade to energy efficiency in the buildings sector, with the following directives:

- directive of 16 December 2002 on the energy performance of buildings
- directive of 6 July 2005 establishing a framework for the setting of eco-design requirements for energy-using products
- directive of 5 April 2006 on energy end-use efficiency and energy services
- directive of 23 April 2009 on the promotion of the use of energy from renewable sources providing for the promotion of energy efficiency
- directive of 21 October 2009 establishing framework for setting of the Ecodesign requirements for energy-related products
- directive of 19 May 2010 on the indication of energy efficiency labelling and standard product information of the consumption of energy and other resources by energy-related products
- directive of 19 May 2010 on the energy performance of buildings
- directive of 25 October 2012 on energy efficiency amending directives 2009/125/EC and 2010/30/EU and repealing directives 2004/8/EC and 2006/32/EC
- directive of 30 May 2018 amending directive 2010/31/EU on energy performance of buildings and directive 2012/27/EU on energy efficiency

Draft

To help officials in EU countries implement the Energy Efficiency Directives, the European Commission has published several guidance notes; Article 5, 6, 7, 8, 9-11, 14, 15. Country-level implementation of these directives should induce important changes in energy efficiency in Europe, especially in the buildings sector. In the United States, the Energy Policy Act of 2005 covers almost every aspect of energy generation, distribution, and consumption, along with guidelines on energy efficiency. In 2012, 31 US states, by adopting either ASHRAE[2] 90.1.2007 or the ICC Energy Conservation 2000-2015[3], implemented model codes for residential and commercial buildings. Their provisions concerning energy efficiency in buildings include: energy consumption reduction targets for public buildings, integrating efficient equipment in public procurement, new standards for 14 large appliances, and tax incentives for energy efficiency improvements in homes, commercial buildings, and public buildings. However, some environmental organizations have criticized the act for making only limited progress towards energy efficiency in buildings (IPCC, GABC).

In rapidly developing countries in which the built environment is largely immature, the buildings sector should prioritize improving energy efficiency and reducing future emissions in new construction. Policies and programs targeting existing building stock will likely have a lower magnitude impact on overall improvement in energy efficiency. This is one aspect in which the developing economies can have a disproportionately large impact on reaching global energy efficiency targets, as the marginal cost of increasing building energy efficiency is lowest at construction time. New construction represents a significant opportunity to integrate efficient materials, new technologies, and best practices from the start. During construction, the entire building system can be designed to optimize energy efficiency. Operational energy consumption is affected by location, orientation, structure, layout, construction materials, and included equipment – all design- and construction-time decisions. Some of these factors can be improved upon later during major renovations but are more capital intensive.

Conversely, in many countries with developed economies and extensive building infrastructure already in place, retrofitting existing buildings to improve energy efficiency and reduce emissions should take priority over new buildings. Consider the built environment in the European Union, which is composed of approximately 35% of buildings 50+ years old: improving their energy efficiencies could reduce the region's total energy consumption by more than 5% (UNECE, 2017a, p. 8).

Policies, programmes, and technologies can be considered to address energy efficiency in buildings from three perspectives: systems, structure, and service. Examples of policies and programmes which support increased energy efficiency in the buildings sector include appliance standards and labels (Energy Star, *et al.*), building energy codes, utility demand-side management programmes and targets, public-sector energy leadership programmes, energy pricing measures and financial incentives, education and training initiatives, targeted awareness programmes, and the promotion of energy service companies (ESCOs) (UNDP, 2009). The level of success of each of these types of policies is dependent upon many factors and may be hindered by various barriers. In addition, the best approach to improving building energy efficiency in each country may depend upon the buildings sector being sufficiently mature, economically, to successfully adapt to the ecological transition. This study links relevant national policies and technological adaptation to identify the gaps between existing energy efficient technologies in buildings and their application and adaptation in the UNECE region, with assessments undertaken at the national level.

[2] ASHRAE 90.1-2007 is the primary document for establishing the BASELINE BUILDING PERFORMANCE standard for the whole building energy simulation. The baseline building performance is the annual energy cost for a building design intended for use as a baseline for rating above standard design.

[3] The International Energy Conservation Code 2015 (IECC 2015) is a model code produced by the International Code Council (ICC). This document provides the foundation for many state and city codes.

The remainder of this report is structured in 4 major sections. Chapter 1 documents the objectives and scope of this study; the methodology used is also detailed along with perceived limitations. Chapter 2 focuses on existing energy efficiency technologies in five broad categories: “Building Envelope and Glazing”, “Heating of Domestic Hot Water Supply”, “Air Conditioning, Ventilation, and Cooling”, “Appliances” and “Lighting”. The review of the application and adaption of the relevant technologies, nation-level assessment, and gap analysis are documented in Chapter 3. This report concludes with Conclusions and Recommendations, which are based on the mapping and gap analysis, focusing on priority actions countries in the UNECE region should take to increase the uptake of technologies to enhance energy efficiency in buildings. Recommendations include, but are not limited to, aspects of policy and legislation, investments and financial incentives, technology adaptation, and capacity development. A set of annexes terminates this report, documenting the data upon which the gap analysis was based. These annexes are organized by country alphabetically within UNECE subregion.

Draft

CHAPTER 1 - Objective, Scope, Methodology, and Limitations

The objective of this study is to identify and analyse gaps between the existing energy efficient technologies in buildings and their application and adaptation in the UNECE region, with assessments undertaken at the national level. This study, "Mapping of Existing Technologies to Enhance Energy Efficiency in Buildings in the UNECE Region", aims to highlight the difference in the use of technologies between countries through gap analysis, to determine if any correlation exists between the strictness and enforcement of existing standards and the level of applied technologies. This study builds upon the comparative study undertaken in 2018 entitled "Mapping of Existing Energy Efficiency Standards and Technologies in Buildings in the UNECE Region" by the UN Committee on Housing and Land Management (CHLM) and the Committee on Sustainable Energy (CSE) on building standards in the UNECE region.

This study undertakes the mapping and clustering of existing technologies to enhance energy efficiency in buildings. It further identifies and analyses the gaps between existing energy efficient technologies in the buildings sector, and their application and adaptation in the UNECE region. The analysis complements the previous reports which were limited, respectively, to building codes and technical requirements, and various social, policy, and financial barriers (UNECE 2017b, UNECE 2018). Specifically, this study extends the initial assessments of energy efficiency technologies in buildings in relation to the existing standards and current barriers.

The primary method of this study is gap analysis based on data gathered mainly through desktop research of both internet and print media, including official governmental communiques, NGO-published reports, academic publications, energy databases, and public news outlets. The data has been validated and the data sources further augmented through consultations with various subject-matter experts and organizations. In continuation of the previous study, the UNECE member States are similarly grouped by subregions A, B, C, D, E, and additionally subregion F[4]. Due to insufficient data, San Marino and Israel were excluded from this study. Countries are assessed on a 3-point scale (Low, Medium, High) for implementation of the building energy efficiency technologies described in Chapter 2. For tabulation and analysis, the technologies were aggregated into five high-level categories: "Building Envelope and Glazing", "Heating of Domestic Hot Water Supply", "Air Conditioning, Ventilation, and Cooling", "Appliances" and "Lighting". Where possible, relevant data was gathered separately for retrofitting existing buildings, and implementation in new construction; then further segregated by four types of buildings: single-family dwellings, multi-family dwellings, commercial buildings, and public buildings.

The data collected to measure and analyse the trends and patterns of application of energy efficient technologies is based on the assessment criteria listed in Table 1, by which implementation of each technology in each country was evaluated to assign an Impact Score. A set of annexes terminates this report, documenting the data upon which the analysis was based. These annexes are organized by country alphabetically within UNECE subregion.

[4] Subregion A = Andorra, Austria, Belgium, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Liechtenstein, Luxembourg, Monaco, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland, United Kingdom.
Subregion B = Bulgaria, Croatia, Cyprus, Czech Republic, Estonia, Hungary, Latvia, Lithuania, Malta, Poland, Romania, Slovakia, Slovenia.
Subregion C = Albania, Armenia, Azerbaijan, Belarus, Bosnia and Herzegovina, Georgia, Kazakhstan, Kyrgyzstan, Montenegro.
Subregion D = Canada, United States of America.
Subregion E = Republic of Moldova, Russian Federation, Serbia, Tajikistan, The former Yugoslav Republic of Macedonia, Turkmenistan, Ukraine, Uzbekistan.
Subregion F = Turkey.

Draft

Table 1 - Impact Score Assessment Criteria

Impact Score	Assessment Criteria
3 (High)	The technology is strongly prevalent. There is governmental support and initiative to encourage promotion of the technology, and there are active measures being undertaken which include financial support and incentives. Application of this technology is mandatory, or in a transition phase to becoming mandatory. There could be fines for non-compliance. This technology might be made affordable and economically feasible through means of incentives and being widely implemented.
2 (Medium)	National legislation (laws, building energy codes etc.) does not require implementation of this technology. There are only some cases when implementation of this technology is supported on the regional level (e.g. in some climate zones etc., but not in the whole country). Some prescriptive recommendations may exist in the legislative documents. This technology is frequently implemented during new construction or retrofits; despite the lack of proper regulatory framework, it may be affordable and widely used. There is a moderate trend of implementation for the technology, but there are still some gap areas which exist. This could be improved with public-private partnerships, government support, push-pull marketing strategies, compliance standards, and financial incentives.
1 (Low)	Existing legislation does not require implementation of this technology. There are also no specific building energy codes that describe at least prescriptive requirements. This technology is only seldom implemented in some regions (including demo-projects, implemented by the international organizations and co-financed by the various funds). The technology is likely economically inefficient. It is being implemented, but at a stage of infancy; market barriers exist which curtail adaptation. Much is mentioned about it in policies, but there is not substantial applicability and efforts are required to promote the technology.
0 (Non-applicable)	Implementation of this technology is not economically feasible and not mandatory. This technology is not applicable (only in some specific cases).
NI – No Information	No information, as of now, on the data point.

The analysis focuses on the following topics relevant to energy efficiency for countries in the UNECE region:

- institutional and legal policy
- building codes and standards
- existing technologies
- local capacity development
- existing availability of materials and equipment
- currently implemented financial and economic mechanisms

This report is based on the principles of Framework Guidelines for Energy Efficiency Standards in Buildings (UNECE 2017c), and thus transcends the incremental, components-based approach of existing building standards analyses. It is well-known that the largest saving potential in energy use occurs when a systems perspective is used to implement energy efficiency improvements, so this basis is appropriate. This design perspective influences the gap analysis and subsequent recommendations. Furthermore, the identified gaps are analysed by highlighting the difference in the use of technologies among countries of the UNECE region.

DRAFT

The scope of the study is limited to evaluating the adaptation of building energy efficiency technologies by UNECE member States, identifying implementation gaps and possible causal barriers, and recommending actions that consider the ecological transition at all levels of building renovations and new building programs. The validity of the conclusions and recommendations in this report is limited by the data which was publicly available through desktop research at the time of study development. Where appropriate in the remainder of the report, specific assumptions which have been made are documented; all conclusions are likewise dependent upon these assumptions. Finally, unlike the aforementioned report (UNECE 2017b), this study is not based on data elicited via a structured survey from subject matter experts. To the extent that said experts hold relevant information that is not publicly available, the conclusions and recommendations here may be biased.

This study was consulted, and results validated, by stakeholders from the UNECE region, relevant national authorities, and members of the UNECE Joint Task Force on Energy Efficiency Standards in Buildings. The preliminary findings of the study were validated at the Third Meeting of the Joint Task Force Commission in Geneva, Switzerland on October 3rd, 2018, and the finalized study presented during the Ninth International Forum on Energy for Sustainable Development, on 12-15th November 2018 in Kyiv, Ukraine.

Draft

CHAPTER 2 – Energy Efficient Technologies in Buildings in the UNECE Region

The buildings sector consumes significant amounts of energy to maintain comfortable living conditions, which requires: space heating and domestic hot water preparation, ventilation and air conditioning/cooling, and power supply for lighting and other household appliances. There are advanced technical solutions for buildings being integrated in modern architecture which reduce energy consumption, carbon emissions, and energy wastage, while providing maximum thermal comfort and safety of the occupants. In general, such technologies either reduce the energy demand, or increase the efficiency with which energy is used. Recently, effective building planning on the construction stage has become increasingly important, which includes: effective planning of eco design, building orientation, effective use of green plant system for the roof, building facades, use of shading systems, planning of natural lighting and natural cross section ventilation, etc.

Modern building regulations define the requirements of building engineering systems and set building envelope thermal performance limits, which also determine the most optimal energy consumption, in terms of technical and economic conditions.

Building codes provide guidelines for new construction and for retrofitting the existing building stock to create high-performance buildings by applying an integrated, holistic design process, which increases building life-span; reduces energy consumption; and contributes to a better, healthier, more comfortable environment for people to live and work. Several technological options exist which, along with providing energy efficient solutions, also support sustainability measures; reduce operating costs and environmental impacts; and increase building adaptability, durability, and resilience. This Chapter focuses on how and where energy is consumed in a building during its operational life, and on relevant existing energy efficient technologies, which have been divided into following six broad categories:

- building envelope and structure; insulation, glazing, airtightness and reduced thermal bridging;
- space heating;
- central air conditioning/cooling;
- water heating and cooling
- appliances and equipment; and
- lighting.

The following are some examples of energy efficient measures (the list of technologies is not prescriptive, and the adequacy of each technology depends on specific region, its climate conditions and other factors) which can be adopted to make buildings efficient and productive:

Thermal protection for enhancing the building envelopes and structure:

- thermal insulation of building envelope;
- replacement of obsolete windows and doors with modern energy-efficient ones;
- increasing the airtightness of buildings (adequate ventilation of premises must be arranged within increasing of air tightness);
- improving design details to reduce thermal bridging in building envelopes.

Decrease heat losses in buildings:

Draft

- restoration and sealing of inter-panel joints of the walls and ceilings, in case of panel building[5] reconstruction;
- installation of additional entrance groups (halls, wind porches) with double doors;
- installation of automatic door closers; and
- installation of heat recovery units to limit heat loss by the ventilation system, and supply fresh and clean air.

Improvement and optimization of internal heat-supply systems, to decrease energy consumption:

- thermal insulation of heating system pipelines, hot water risers, and heating system distribution mains;
- installation of automatic individual heat points for the heat supply system;
- installation of thermostats for the heating system radiators;
- installation of balancing valves on the heating system risers;
- installation of heat- and water-heating boilers (including biofuel) with weather-compensating controls;
- use of circulating pumps for heating systems, hot water supply with built-in or external frequency converter drives;
- installation of reflective insulation behind radiators; and
- hydro-pneumatic or chemical cleaning of heat supply systems, including basic equipment.

Reduction or optimization of electricity consumption:

- replacement of lamps and bulbs in internal and external lighting systems;
- use of scheduling / occupant or daylight sensors for lighting controls;
- use of high-efficiency electric heating/cooling equipment (heat pump);
- optimization of energy consumption by elevators with installation of frequency converter drives;
- use of frequency converters in the engineering building systems to optimize the operation of fans, pumps, and other relevant equipment;
- installation of energy-efficient household appliances; and
- installation of photovoltaic heating and power-generating systems (solar panels).

Some of the basic energy efficiency measures are described in the rest of this chapter, highlighting their impacts on energy consumption and applicability in the UNECE regions.

2.1. Building Envelope: Insulation and Glazing

2.1.a Insulation of building envelope, airtightness, thermal bridging.

The building envelope has the greatest impact on buildings performance; it is a prime focus area to consider when energy efficiency measures are planned for existing or new buildings. Considering the functions of the building envelope, i.e. security, comfort, shelter, privacy, aesthetics, ventilation, etc., it is imperative to optimize the design of the building envelope to meet the occupants' requirements while reducing energy consumption and heat loss.

The importance of thermal insulation, airtightness and reducing thermal bridging in buildings is equally relevant for countries in both hot and cold climates. Heat loss through leakage during cold months leads to increased use of heating energy, this is analogous to losing cool air from central air conditioning due to high heat gain in premises in summer months (both situations resulting in increased consumption and higher carbon emissions). Most building heat loss is through the walls, roofs, and floors and glazing, sealing joints, thermal bridges etc.

[5] Panel building is a building constructed of large, prefabricated concrete slabs / panels.

Draft

Adequate levels of insulation as well as reduce of thermal bridging are critical measures for improving thermal performance and comfort, but also to ensure long-term building durability.

Proper insulation can reduce the heat loss in cold climates and heat gain in hot climates. The type and amount of insulation varies according to climate, building type and usage. There are many available energy efficient technologies which address the building envelope that are predominantly applied to new buildings. Some may also be implemented during retrofit upgrades, as applicable.

Insulation layer thickness selection is based on the requirements of the construction and regulatory criteria, climate conditions, current thermal, and other necessary parameters. All of which should be considered in the architectural design stage. The principles of some technical solutions for insulation of external walls and for attic/ ground floor or basement slab (included, but not limited) are illustrated in Figure 1.

Principle for exterior wall insulation	
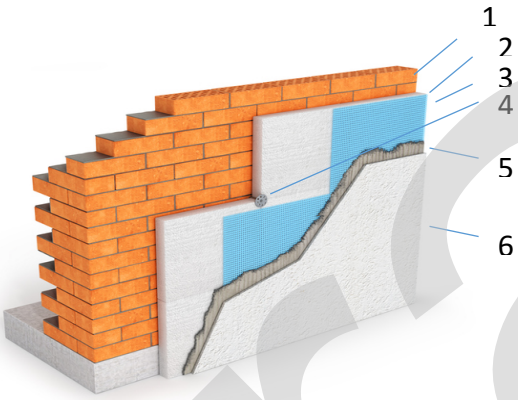	Key elements of the proposed technology 1. The existing concrete wall 2. Adhesive composition 3. Insulation plate 4. Fixing plug 5. Reinforcing fiberglass mesh is applied to the adhesive composition 6. Outer protective and decorative coating with preliminary primer layer
Principle for insulation of the attic floor	
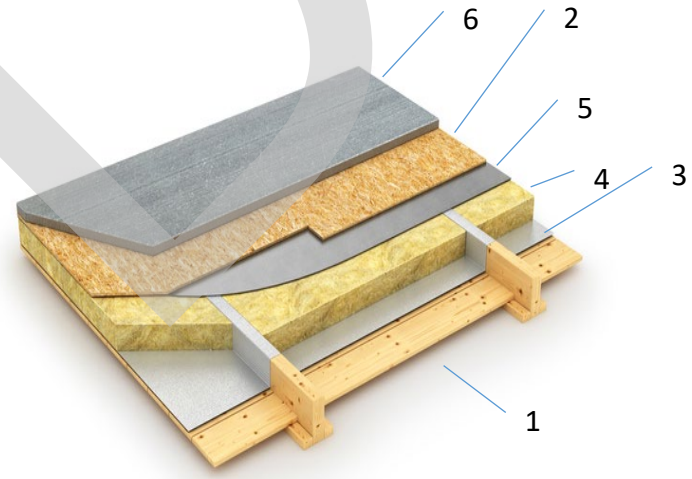	Key elements of the proposed technology 1. The existing attic slab 2. Plywood smoothing sheet 3. Air barrier (vapor control layer in some assemblies) 4. Insulation plate 5. Hydroisolation 6. Final floor coating

Figure 1 - Technical solutions for insulation

Draft

Some of a wide range of thermal insulation materials used in buildings in the UNECE countries to promote energy efficiency are shown in Figure 2.

	Fiberglass	Rock wool	Slag wool	Expanded polystyrene (Frothed non-pressed)	Extruded polystyrene
VIEW				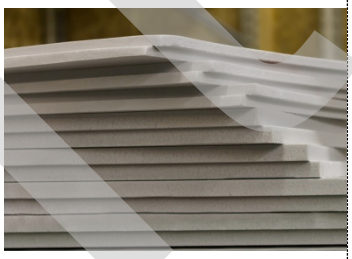	
CHARACTERISTIC	Initial raw materials for production of fiberglass are: sand, soda, limestone, drill (or etibor), cullet. Heat conductivity - 0,038-0,046 W/m·K. Max operational temperature - 450 °C. Min. operational temperature -60 °C.	The main raw materials for production of stone (basalt) cotton wool are rocks. Heat conductivity - 0,035 — 0,042 W/m•K. Max operational temperature – up to 1000 °C (only in case of lack of deformation).	Initial material for production of slag cotton wool are domain slags. Heat conductivity - 0,04 - 0,07 W/m•K. Max operational temperature - 300 °C.	Expanded polystyrene (or polyfoam) stands for the foam plastic which consists for 98% of air. Heat conductivity - 0,036 - 0,050 W/m•K Max operational temperature - +70 °C. Min operational temperature - 50 °C.	Extruded expanded polystyrene consists of the granules of polystyrene formed by an extrusion method. Heat conductivity - 0,028 -0,034W/m•K Max operational temperature - +75 °C. Min operational temperature - 50 °C.
ADVANTAGES	• Lightness • Elasticity • Good sound-proofing properties; • Nonflammable • High compression for easy transport	• Nonflammable • High elasticity • Immunity to mold and fungus • Resistance to short-term influence of moisture – can be mounted during rain • Fibers are noncaustic	• Low water absorption – is ideal for work under the open sky in any weather	• Low price • Excellent flexibility • High durability on compression at the low density • Simplicity of installation	• High durability on compression at the low density • Low water absorption • Low vapor permeability • Low coefficient of heat conductivity
DISADVANTAGES	• High fragility of fibers • High water absorption	• Low compression of material; inconvenient for transport • High cost	• High fragility of fibers • Low indicators of heat conductivity	• FlammabilityHigh water absorption • Repeated transition of temperature through 0ºC leads to destruction	• Group of combustibility G1-G4 (combustible) • High cost
RESTRICTIONS	It is necessary to use the coveralls made of a dense material, gloves, respirator, and safety glasses during installation.	Requires careful transport and protection against mechanical influences.	Not recommended to use together with metallic facade elements.	Prohibited to use without covering – requires cement and sand or plaster protection from the open environment.	Prohibited to use without covering – requires cement and sand or plaster protection from the open environment.

Figure 2 – Insulation materials applied in the UNECE region

Draft

2.1.b Installation of modern windows with higher thermal characteristics

Replacing outdated windows with the latest window technology insulation is much more efficient than repairing them. Building standards in several countries require the installation of energy efficient windows with high thermal characteristics. These windows are made using multi-chamber glazing profiles, which is a more complicated design than traditional old wooden-paneled windows. As well as having advanced thermal characteristics, multi-chamber windows are stronger, resist deformation, have longer durability. Windows made of a broad range of materials are available, the comparison of main technologies is shown in Figure 3.

Wooden profile	Aluminum profile	PVC profile
		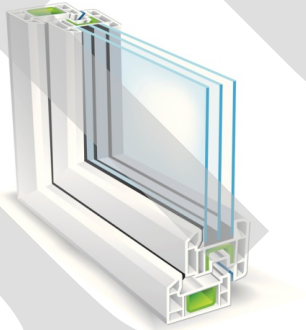
Wooden windows made usually of oak, pine, ash tree or larch. **Advantages:** • Attractiveness • Good thermal insulation and frost resistance • Sound insulation • Possibility of changing color either outside or inside **Disadvantages:** • Combustibility and hygroscopicity • Ongoing maintenance / finishing required	Aluminum windows are divided into two types: light and warm aluminum. Windows made of **light aluminum** are suitable for buildings which do not require significant sound and heat isolation. Such windows are very light and small. **Warm aluminum windows** consist of two parts: external – cold, and internal – warm. These parts are produced separately and later merged directly on the building. **Advantages:** • Lightness • Durability • Resistance to weather conditions • Possibility to customize the configuration and complexity of the window **Disadvantages:** • Susceptibility to electrochemical corrosion • High thermal conductivity of the aluminum – requires thermally broken frames to achieve high performance levels	These windows are made of polyvinylchloride (PVC); **Advantages:** • Good thermal insulation • Excellent sound insulation • Resistance to various atmospheric actions • Simple operation and maintenance **Disadvantages:** • Mechanical damages of a plastic window cannot be corrected

Figure 3 – Energy efficient window profiles

The design of double-glazed or triple-glazed window units (for the regions where it applies) consists of sheets of glass divided by a spacer which is hermetically sealed on each end. The glass panes are separated by air, or filled with gas, to reduce heat transfer.

Draft

Depending on the thermal and technical requirements, window profiles can be specified in accordance with the building regulations or requirements, for instance acoustic insulation. In many countries, windows have energy saving glazing, which has a glass panel coated with a thin layer of silver atoms; this can decrease the glazing emissivity significantly. This type of single-chamber double-glazed window is warmer than the simple double-chamber ones. At the same time, it weighs about 30% less, which contributes to a longer lifespan. Moreover, due to the silver ions, this type of double-glazed window exhibits the mirror effect. This enhanced reflectivity allows the windows to help a room stay cooler during the summer, and warmer in the winter.

The importance of proper window installation by highly qualified specialists should be highlighted in order to reduce thermal bridges and ensure proper air tightness of the window.

2.2. Heating, domestic hot water supply

Different approaches to the design of heat supply system depend largely on the availability of energy resources, price, infrastructure, technological development, and energy policy of a specific country. Heat supply system technology is in a transition phase, and there are significant technological advancements being made to include renewable energy as a source of heat supply. The following governmental support measures are important for the implementation of the renewable energy:

- development of proper legal framework and policy
- establishment of targets for promoting renewable energy sources for use in electricity or heating
- provision of financial / fiscal incentives for investment in renewables
- adoption of medium-term feed-in tariffs for the purchase of renewable energy
- imposition of an obligation on power companies to secure a certain percentage of their supplies from renewable sources.

The implementation of the renewable energy solutions can be applied both for centralized and decentralized heat supply systems.

2.2.a Improvement of decentralized heating supply system

The principle of decentralized heat supply is based on independently-produced heat energy for internal needs. Decentralized heating systems can rely on both non-renewable fuel (e.g. installation of boiler equipment) and renewable energy (installation of roof-top solar collector systems and heat pumps[6]).

Installation of the boiler equipment

One of the most widespread measures within the modernization of the decentralized heat supply system is the replacement of the outdated boilers with the more efficient ones (for the regions where it applies). The efficiency of the new boiler equipment can be determined by the efficiency in energy generation

[6] A heat pump can be truly renewable only when the electricity used to drive the pump comes from a non-fossil fuel source. Additionally, according to the EU Directive 2009/28/EC, point 31: "Heat pumps enabling the use of aerothermal, geothermal or hydrothermal heat at a useful temperature level need electricity or other auxiliary energy to function. The energy used to drive heat pumps should therefore be deducted from the total usable heat. Only heat pumps with an output that significantly exceeds the primary energy needed to drive it should be taken into account."

Draft

from fuel combusted. The coefficient that defines the efficiency of boilers is called efficiency coefficient. The higher coefficient of boiler efficiency means the input of fuel required is less for the heat generation or for hot water supply. The modernized boiler equipment has a higher efficiency coefficient from combusting similar amount of fuel type as compared to the traditional boilers.

Moreover, the technology allows the boiler to switch over to different fuel type with higher calorific values along with the additional feature, the automatic heat regulation systems coupled with weather compensated control.

There are different types of the boiler equipment, which operate using the various fuel types such as: natural gas-fired boilers, diesel, coal, electric and biomass (see Figure 4).

One of the most efficient boiler technologies is condensing boilers, which are more efficient than traditional boilers. The use of the condensation of the water vapor, formed as a result of the hydrocarbon combustion process, is considered as the most innovative boiler technology. Condensing boilers operate according to this principle.

The EU Directive 2009/125/EC (establishing a framework for setting eco design requirements for energy-related products) forbids the sale of non-condensing gas-fired boilers in the entire EU region, barring a few exceptions. The higher efficiency and environmental-friendliness of condensing boilers make them superior to traditional gas-fired boilers. Currently, all European manufacturers are obliged to produce only condensing gas-heating equipment for sale in the EU countries.

Figure 4 - Examples of modern gas-fired boilers

Solar collector solutions

Solar heating is one of the most widely-used technical solution using renewable energy in the buildings sector. Heat from solar radiation can be used for domestic hot water and internal heating in residential or public buildings. There are two types of solar collectors: flat and vacuum tube collectors (see Table 3). The typical solar collectors generate temperatures of 60-100°C.

Draft

Table 2 - Types of solar collectors

Flat solar collectors	Vacuum tube collectors
Advantages	
• Low cost solution • Easy to install and maintain • Simple to operate and generally no other equipment required (such as pumps) • Proven technology with significant lifetime (more than 25 years) • Ideal for intermittent loads (e.g. houses, restaurants, and small businesses) • Transparent insulation can be equipped for flat collectors to achieve a higher efficiency. It can be used to reach the higher target temperatures or applicable in cold climate to protect collector against the freeze. This variant also has overheating prevention at the collector level.	• Higher efficiency compared to flat collectors • Ideal for high and constant loads (hotels, spa, swimming pools and gyms) • Ideal for solar cooling and heating; temperatures can range from 50°C in winter to 120°C in summer • Cover winter load, except in extreme conditions • Not prone to damage from heavy snow or hail
Disadvantages	
• Lower efficiency compared to vacuum tube collectors • Temperature range not ideal for solar cooling; during extended winter periods, cannot accommodate the DHW (domestic hot water) load; • Sensitive to damage from extreme snowfall or hail	• They are a relatively expensive solution • Not ideal for small DHW loads (such as houses) • Hot summer conditions may cause glycol pyrolysis if there is no constant consumption or water circulation (temperatures may rise above 130°C) • Prone to being damaged if used for intermittent loads • Low electricity consumption due to the need for forced recirculation, especially during summer

Solar systems can be divided into two key categories: passive and active (see Figure 5). The passive solar system is installed as one complete rooftop unit comprised of a solar collector and water tank. This system is relatively less expensive but at the same time it is not appropriate for use in the cold climates.

Active solar water heating and heat supply systems include a wide range of engineering equipment: solar collectors, controllers, circulation pump, broad tank, main storage container, and connecting pipes. Active systems are more expensive, but give more benefits and can be used during the winter season. Electric heating provides for the necessary water temperature, especially during cloudy weather with lower levels of radiation. In general, these systems consume less electricity annually. Active systems can be used not only for water heating, but also for heat supply systems. Further, it is possible to adjust the capacity of active solar systems (within specified limits) by means of adding more solar collectors. For example, in case if it is necessary to heat more water or to increase the heating area.

Draft

View of passive solar system with flat collectors

View of active solar system with vacuum tube collectors

Figure 5 - Examples of solar heating systems

Heat pumps

A heat pump operates on the principle of vapor-compression cooling. Heat power is carried by means of condensation and evaporation of a coolant (generally, Freon circulating within the closed contours). Heat pumps consume electricity to operate the coolant compressor and secondary circuit circulation pumps. There are several key points on installation of heat pumps in the buildings sector:

1. Installation of heat pumps systems is economically feasible when installed at the time of construction, as it is easier to make provision for space. During a building retrofit, it may be possible to integrate a heat pump into existing heat supply system along with a heat collector.
2. In cold climates and warm seasons, heat pumps using a water source can work more effectively than air-based heat pumps, or other air conditioning systems. Heat pumps are much more efficient than other electric heating systems and, depending on fuel prices, they can be also more economic than other heating systems.
3. Heat pumps demonstrate outstanding efficiency when daytime temperatures fluctuate drastically.
4. Heat pumps are economically feasible in countries where fossil fuel (e.g. natural gas) is relatively expensive compared to electricity, or not available. Heat pump systems have lower energy costs, when the electricity price (for kW) is 3.5 times higher than the price of traditional fuel (for production of 1 kW).
5. In areas where drilling is relatively cheaper, geothermal systems with a vertical soil heat exchanger are the most attractive. However, flat geothermal systems (low depth, wide area) can also work well if there are large areas on the property which can be used for this purpose.

Heat pumps may be classified according to the source of low-potential thermal power, as shown in Figure 6.

Draft

TYPE	SOIL – WATER		WATER – WATER		AIR - WATER
	Horizontal	Vertical	Horizontal	Vertical	
VIEW			 Principal diagram of heat pump with vertical collectors		
DESIGN	The collector is placed in the form of rings or twisting inside the horizontal trenches lower than the depth of frost penetration into the soil (usually at least 1.20m).	The collector is placed vertically in a well up to 200m in depth.	The collector is placed in the form of rings or twisting in a water reservoir (lake, pond, river) lower than the frost penetration depth.	The collector is placed vertically in a well, and the second well is located in downstream water in an underground layer of 15-20m.	The units consist either of two blocks, which are placed outside and inside the building, or of monoblock connected with the external space by a flexible air duct.
APPLICATION	This method is the most economically feasible for residential buildings, in case if land plot area is available to place horizontal collector	Is applied in cases when the land plot area does not allow to place the contour horizontally or there is the threat of landscape damage.	This is the cost effective solution, but this solution has requirements to the water reservoir	Is applied in case of a sufficient amount of ground waters and the site size, which allows the placement of two wells.	This variant is applicable and not expensive. Although the capacity of these units is reduced, they are sustainable and operate at temperatures as low as -15°C. Then it is necessary to connect another heat energy source.

Figure 6- Types of heat pumps

Draft

2.2.b Improvement of centralized heating supply system

The centralized district heating supply consists of a heat energy source, distribution heating network, and an individual heat point of transformation of heat power, which has a connection to the consumer which are internal heating systems of building. Each of the previously listed items have an important role in reliable and quality heat supply of the buildings; please see Figure 7.

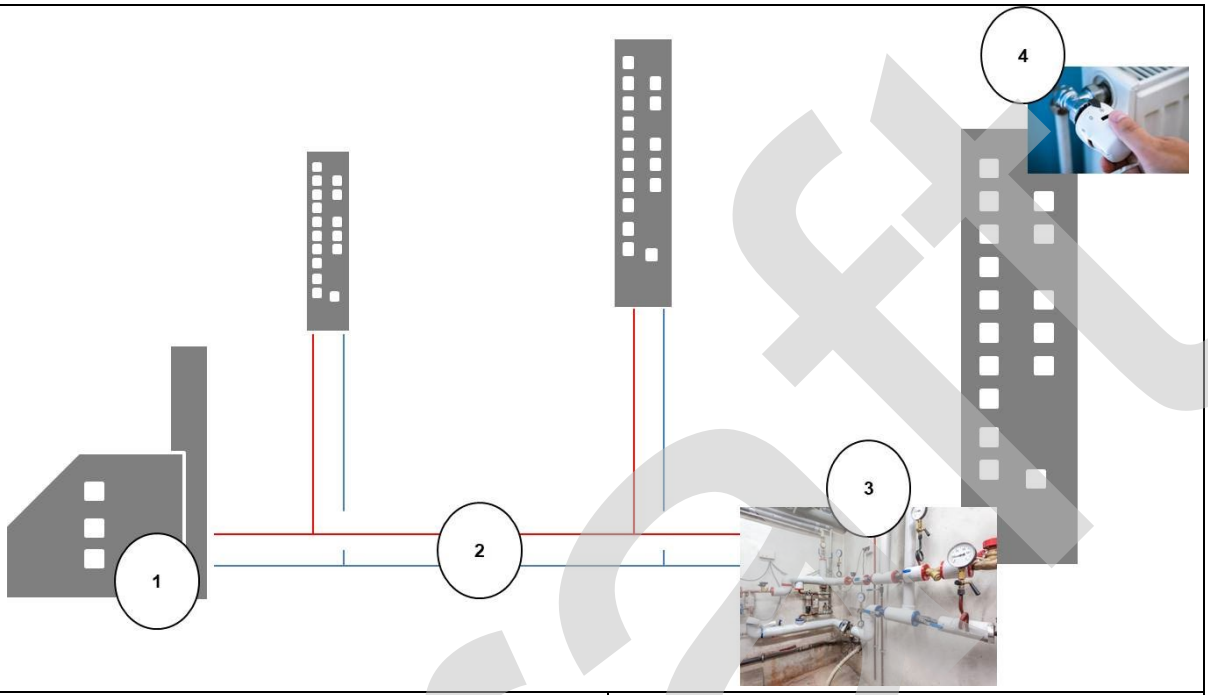

View of principal diagram of centralized district heating

Main elements	
1	Central heating plant/central boiler
2	District heating network
3	Heat individual point
4	Internal heating system of building

Figure 7 - Diagram of centralized district heating system

Multi-family residential, public and commercial buildings are usually equipped with engineering systems which include heating, ventilation, and air conditioning (HVAC), and hot water supply. Regardless of the building purpose and size, all engineering systems should provide comfort conditions for occupants, safety, and reliability of supply whilst saving energy and reducing CO_2 emissions. The centralized heating system configuration is an intensive operating system; for instance, the load of heating and ventilation systems depend on the outdoor air temperature and heat release in the premises, as well as the work of the domestic hot water supply system.

The implementation of the district heating systems requires a complex automation system within the building heat supply systems, covering the heat points and heat consuming systems. In many countries, the centralized heat power supply system uses an automated control system, which is an obligatory measure in new buildings and for retrofits.

Draft

Figure 8 - Individual automatic heat point with weather compensation control

The most significant energy saving impact from heat consumption systems can be achieved with the application of automatic heating individual point, which have the following basic functions:

- adjustment of the temperature of hot water supplied into the heating system, depending on the outdoor air temperature (weather compensation control);
- adjustment of the temperature of the hot water, which returns from the building's internal heating system to the district heating network in line with the outdoor air temperature as per the set temperature schedule;
- accelerated warming-up of the building after energy saving mode (reduced heat consumption);
- correction of the heat consumption according to the indoor air temperature in the premises;
- hot water temperature constraint in the heating supply system pipelines;
- adjustment of the heat load in the hot water supply system;
- adjustment of the heat load by the ventilation units with the freezing protective function;
- adjustment of the heat consumption reduction within the set periods, in accordance with the outdoor air temperature; and
- adjustment of heat consumption, considering the orientation of the building and its ability to act as a heat sink.

In many countries, the hands-on experience in modernizing the heat points has proved the effectiveness of this measure

2.2.c System performance optimization measures

Insulation of pipes and equipment

Figure 9 shows the insulation of pipelines for both cold-and heat-power supply systems, which is a necessary measure in new constructions and building retrofits. Insulating pipelines by wrapping with insulation materials not only reduces the heat losses in the pipelines, but also provides the estimated heat carrier temperature at the same level. Insulated pipelines keep their temperatures better, leading to substantial energy savings.

Draft

Figure 9 - Pipe insulation and insulated distribution pipes of HVAC systems

There are several types of thermal insulation materials for pipelines available in the market. The application of thermal insulation for cold and heat power supply systems is an obligatory measure for new constructions and retrofits in many countries. In case of retrofits, the pipeline insulation should only be performed after pipelines are repaired and pressure-tested, which usually include the following activities:

- dismantling of any existing thermal insulation;
- cleaning of the pipeline surface;
- replacement of pipeline portions as necessary; and
- installation of the thermal insulation.

Installation of thermostatic regulators on radiators

Control of temperature in individual rooms is a fundamental for rational use of energy. In the common case of radiator heating, the significant heat saving can be achieved by installing the thermostatic valves on radiators. For other types of heat emission systems, such as floor heating or fan-coils in offices, the same logic applies.

Thermostatic regulators consist of two parts: a valve and a thermostatic element, as shown in Figure 10.

Figure 10 - Thermostatic radiator control elements

Thermostatic valves are usually installed in the heating system before the radiator. These thermostats can be adjusted by the building occupants according to the desired indoor temperature. The key working element of a thermostat is the thermostatic element, which has a temperature-sensing element inside controlling, together with the valve, the water flow into the radiator.

By reducing/avoiding the excessive heat supply when the ambient temperature corresponds to occupants' preferences, the thermostat prevents over-heating of the premises and maintains ambient

Draft

comfort. By means of automated regulation of the air temperature, radiator thermostats allow, depending on users' behavior, to energy savings of heating system of the building. In their absence, temperatures overshoot and occupants will remove excess heat by opening the windows.

Installation of thermostats on radiators is coupled with the replacement of outdated heating devices with higher energy efficient systems (higher thermal performance).

Installation of the balancing valves

Balancing valves are part of clearance pipe fittings, intended for the circulation of hydraulic balancing rings (risers, branches) of the cold and heat power supply systems. Optimization of system performance should be done for dynamically varying real-life building operation conditions, providing stabilization of the dynamic regimes of its work. They can be seen in Figure 11.

Figure 11- Balancing valves for HVAC systems

The application of balancing valves, in particular dynamic balancing by differential pressure control, provides the following benefits for systems of cold and heat power supply:

- ensuring hydraulic stability and the optimal operational conditions of the system elements heat emitters and their controls, heat distribution system, heat generator;
- ensuring that the right amount of energy, at the right time, at the right place is available across the entire building – in particular dynamic balancing functionality;
- reduction of the noise level of the different elements operation, for instance radiator thermostats for heat supply system or regulating valves for the fan coils in the cold supply systems, by means of automatically maintained drop pressure at the same level;
- reduction of the noise level in pipelines and other elements by means of restricting the maximum heat carrier flow;
- stabilization of the heat, cold supply, and ventilation systems during periods of extended continuous operation by means of compensation which increases the resistance of hydraulic elements to corrosion and scum;
- simplification of the installation and maintenance of the systems by means of combining the functions of overlapping part, descent of the heat carrier and air, which gives the possibility of computer diagnosis of the heating and ventilation systems;
- possibility to divide the heat or cooling system of the building into temperature zones, i.e. into floor- or apartment-specific systems (one of the directions of energy saving);

Draft

- reduction of energy consumption by circulating pumps; and
- provision of an additional economic and hygiene benefit by preventing diversion of the heat carrier in the heating and ventilation systems.

The functionality of dynamic balancing is provided by automated balancing valves for risers or for each heat emitter. They are recommended to be installed with the default presets; where solutions for risers are chosen, they should be installed on each riser of the heating systems and only afterwards should their settings be tuned. The implementation of this measure should be done after the development of the design documentation, and after the heating system is flushed. By the reparation of heat and cold supply systems, it is reasonable to install balancing valves together with other measures. During installation of balancing valves, it is necessary to consider the commissioning works which should be performed by the specialized organization.

Energy Monitoring and Smart Metering System

Energy monitoring and smart metering system consists of hardware and software components. The overall structure of the technical part can be represented as a three-level system. The lower (first) level of the system combines smart meters with digital telemetry and pulse outputs, pulse counting device, interface converters, transceivers, as well as all components of the infrastructure related to the construction of information communication channels with higher (second) level.

EMSMS includes three levels of components:

- Measuring components (smart meters) - control and measuring system which measures the parameters of resources consumption, forms and provides primary data (measurement results) on the quantity and quality of resources consumed, provides intermediate storage of all received (unmodified) information for each automation object (measurement, diagnosis, scheduling and other results), in accordance with the required periods of storage;
- Linking components - consist of devices intended for the reception of measuring data and signals of faulty measuring components and transferring them to be processed by the computing components.
- Computing components – a unified computer center for data processing, analysis, storage and distribution of information resources. At this level, the resulting data is generated based on the information obtained from measuring the components.

2.3 Air conditioning, Ventilation and Cooling

2.3a Application of Frequency converter Drives for the for electric motors of pumps and fans

Modern building engineering systems have a variable operating mode (ability to change parameters or characteristics during the operation of system), allowing for the reduction of designed parameters of the fresh-air, heating, cooling, hot or cold water in building engineering systems. These parameters must be optimally set to maintain proper ambient climate conditions, and to ensure more efficient energy consumption. These changes are influenced by the fact that all of modern engineering systems have a dynamic mode of operation, which adjusts to constant changes of factors (outdoor climate conditions which influence the building, indoor heat gain from solar irradiation, equipment or people, occupancy changes, changes of the current level of energy, heat or cold-water consumption, etc.).

Draft

The use of frequency converter drives (FCD) for pump and fan electric motors of all engineering systems in buildings helps to optimize and adopt these systems' operational parameters. As part of adapting the basic parameters of engineering systems, FCD reduce the spinning rate of electric motors, and hence reduce power consumption. This change is typically controlled by pressure, temperature, flow, and CO_2 sensors. FCD are very efficient and extensively applied in many countries. As an example, application of FCD for fans of outdoor condenser units of central cooling system can:

- reduce power consumed by compressors;
- significantly reduce energy consumption by fan electrical motors;
- increase fan resource;
- reduce noise; and
- support the floating condensing pressure function.

Figure 12 – Frequency converters

2.3.b Application of heat recovery for centralized mechanical inlet and outlet ventilation systems

Heat recovery is a process of extracting heat from air which is expelled from a building via outlet ventilation, and then injecting that heat back into the supply air coming in through inlet ventilation. This reduces energy consumption for space heating, due to the additional (intermediate) heating of air in the recuperator. A recuperator is a heat transfer device whereby cold air is heated by warmer exhaust. The heat transfer occurs across the plates of a heat exchanger, where the two volumes of air are not allowed to mix.

Figure 13 - Heat recovery unit for mechanical inlet and outlet ventilation

Draft

2.3.c Application of cooling system with variable flow

Modern cooling systems with variable coolant consumption (ability of cooling system to change the cooling demand during its operation) are widely applied in public buildings, where the centralized air conditioning system includes typical air handling units as well as fan coils and other appliances. The hydraulic system of a building cooling system is divided into the primary and secondary contour. The chiller (the cold energy source) is connected to the primary circuit, while the fan coils and air conditioning units are attached to the secondary contour. A group of circulation pumps and the shut off and balancing valves are also part of the hydraulic system. The traditional approach in design and operation of cooling systems is based on systems with a constant consumption of coolant. It means that the coolant is continuously supplied from the chiller through pipelines, which distribute it to the consuming devices. Such traditional approach is not energy efficient because it requires constant consumption of electricity. The application of the new systems with a variable consumption of coolant allows to implement the technical solutions aimed at reducing the amount of consumed cooling water depending on the needs of the end users. Therefore, the operational costs of coolant pumping significantly reduce in the system of cold supply with the subsequent possibility of change of the produced cold energy by the chiller. The use of circulation pumps with a variable consumption in a secondary hydraulic contour allows to decrease the energy consumption of pump groups.

2.4 Energy efficient appliances (EE labeling)

Application of energy efficient appliance labeling is one of the measures for reducing internal electrical consumption on the consumer level. Every type of building includes a large number of household or office equipment: copiers, printers, intercoms, kettles, refrigerators, freezers, washing machines, dishwashers, electric stoves etc. Home appliances consume a significant share of household electricity.

The use of household appliances with a A class of energy efficiency is an efficient way to reduce energy consumption, as well as contribute to the ecological footprint of buildings. In this regard electrical appliances can be certified according to the standards ISO 9001 and ISO 14001, which indicate that no hazardous substances harming nature have been used. The biggest part of large-size household appliances must be certified and properly labeled in accordance with the European energy efficiency class (from G to A+++). The class of energy efficiency should be reflected on a special label applied on the electrical appliance, such as that is shown in Figure 14.

Home appliances of energy efficiency A class and higher can significantly reduce energy consumption. Labels typically include the following information: • Title, model, producer; • Class of energy efficiency: color code with alphabetic reference (from A to G), which reflects the level of energy consumption; • Level of annual energy consumption; • Additional information regarding the type of the appliance, e.g. the internal volume of the refrigerator in liters, the maximum speed of rotation for washing machines etc.; and • Noise level expressed in Decibels.	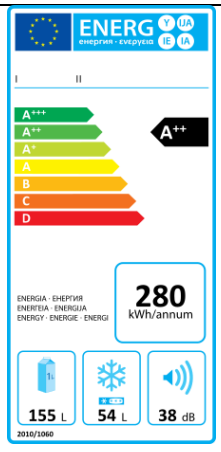

Figure 14 - Energy efficiency labeling

Draft

2.5 Modernization of existing lighting system of the building

Modernization of the existing lighting system in residential building is aimed at replacing incandescent lamps with energy efficient lamps or modules. Multifamily residential and municipal public buildings usually use either filament or fluorescent lamps and in some cases LEDs (see Figure 16). However, there are different opportunities to optimize the lighting systems for example, in the public areas (such as staircases, common laundries, cellars, attics, etc.) of buildings, e.g.:

- replacement outdated inefficient lamps;
- installation of lighting management systems with sensors; and
- accompanying actions.

Energy saving lamps can be characterized by their lower energy consumption and longer service life. At the same time these lamps do not require any additional operational cost or maintenance. Bulb replacement can be implemented both on the individual level (installation of the energy saving lighting appliances by inhabitants in their houses) and by the building owners (installation of energy saving lamps and modules in the public areas, such as stairs, entrance tambours, outdoor lighting systems).

There are many types of lighting appliances for internal building lighting systems with various ingress protection classes. The most efficient and at the same time simple and affordable solution is the replacement of the existing outdated lamps with the energy efficient ones. Nowadays the most widespread light-emitting diode (LED) or compact fluorescent lamp (CFL) lighting appliances, equipped with motion sensors. There are also different types of lighting appliances with built-in devices providing emergency lighting in case of a power outage.

Motion- and thermo-sensitive devices can detect the absence/presence of people and turn off/on the lights as appropriate. Ambient-light sensors can do the same, toggling lights in the presence or absence of sufficient ambient light. These kinds of controls can include automatic dimming as well as switch scheduling. The economic attractiveness of sensor-based lighting controls are building specific, depending on factors such as operational hours, occupant behavior, electricity prices, etc.

In order to enhance the energy efficiency benefit in buildings, it is reasonable to implement a lighting management system, which preferably automated or by installation of dimmers (reducing the lighting appliances luminescence). It is also possible to adjust the lighting system in accordance with the sunrise and sunset calendar.

In addition to providing better illumination, the following measures can also be implemented to improve the efficiency of energy consumption for building lighting:

- to maintain the purity of plafonds;
- not to curtain and not to block the front windows;
- to use pale wall colors (which better reflects the light); and
- to install the lighting modules on the ceiling only, but not on the walls, because this leads to the lighting losing its capacity.

Draft

Figure 15 - LED lamps

Draft

CHAPTER 3 - Current Deployment of Energy Efficient Technologies - Data Analysis and Review

Much progress has been made globally towards improving energy efficiency in the buildings sector, helped along primarily by three types of public policy tools: legal requirements (such as building standards), financial incentives (rebates, reduced-rate debt, tax deductions), and informational awareness programmes. In the European Union, the EU directives have played a vital role in promoting energy efficiency in the buildings sector; “Energy efficiency first" is a key element of the EU directives. However, despite these efforts, energy efficiency in the building sector is improving only incrementally and in disjoint fragments.

In search of the gaps between what technologies are available in the market and what is used by countries, data obtained from UNECE member States has been analysed to identify instructive differences, lessons learned, and best practices in the buildings sector. The ultimate goal of this study is to understand and elucidate the current energy efficiency trends and patterns in the buildings sector in the UNECE region. This chapter documents the data analysis for the major classifications of energy efficiency technologies detailed in Chapter 2, across the UNECE countries. Results are presented in two sections: subregions A, B, and D (EU member states, EU enlargement, and North America), followed by subregions C, E, and F (Eastern Europe, Caucasus, Central Asia, Russian Federation, South East Europe, and Turkey).

Subregions A, B, and D

Building Envelope: Insulation and Glazing

Strict adherence to the EU directive 2018/844 of 30 May 2018, amending directives 2010/31/EU on energy performance of buildings and 2012/27/EU on promoting implementation of energy efficiency in buildings has significantly increased adoption of energy efficiency technologies in the buildings sector. These directives have had far-reaching consequences, one of which is that most countries in subregions A and B are aggressively installing building insulation and windows with high energy efficiency ratings. In addition, energy performance certificates are generating real economic value for building owners. One study (CCC,2016) found that residences in the Netherlands with A, B, or C ratings generated a nearly 4% premium. In Ireland, A- and B-rated homes showed premiums of 9% and 5% over D-rated homes, respectively; the market assigned a discount of over 10% to homes with F and G ratings. Building owners are hence able to earn a profit on energy efficiency investments from both reduced energy consumption and increased economic rents. Figure 17 and Figure 18 display the mix of building envelope technology, for both new construction and existing buildings respectively, by subregion A country. In these and all other similar figures, each bar in each stack represents the average impact score for that technology, across all building types, for that country.

The Passivhaus concept is being further extended by the Powerhouse Consortium in Norway, who is developing the Powerhouse design concept, in which a building is designed to be net positive for energy over its entire lifecycle – including construction and demolition.

The final major impact throughout the European Union is the requirement for new buildings to meet the nearly zero-energy buildings (NZEB) standard. NZEB are designed to be highly efficient and use renewable sources to generate the low amounts of energy they consume. In subregion A, Belgium and Germany have taken the NZEB standard one step further and are implementing the

Draft

Passivhaus standard for both new and existing buildings. This standard has more stringent requirements for space heating/cooling energy consumption, air tightness, and energy generation.

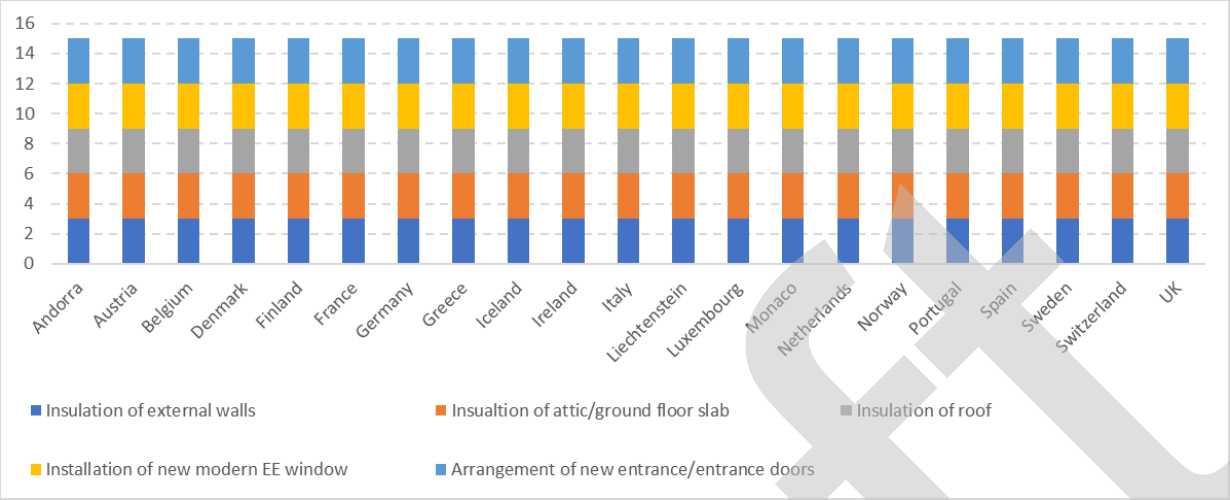

Figure 16 - New construction building envelope technology mix in subregion A.

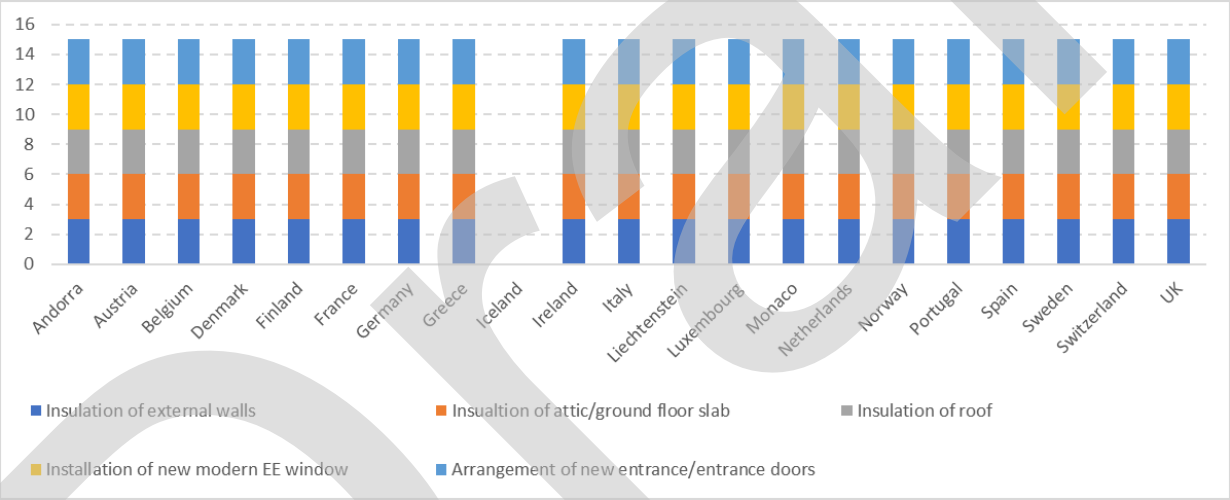

Figure 17 - Retrofits building envelope technology mix in subregion A.

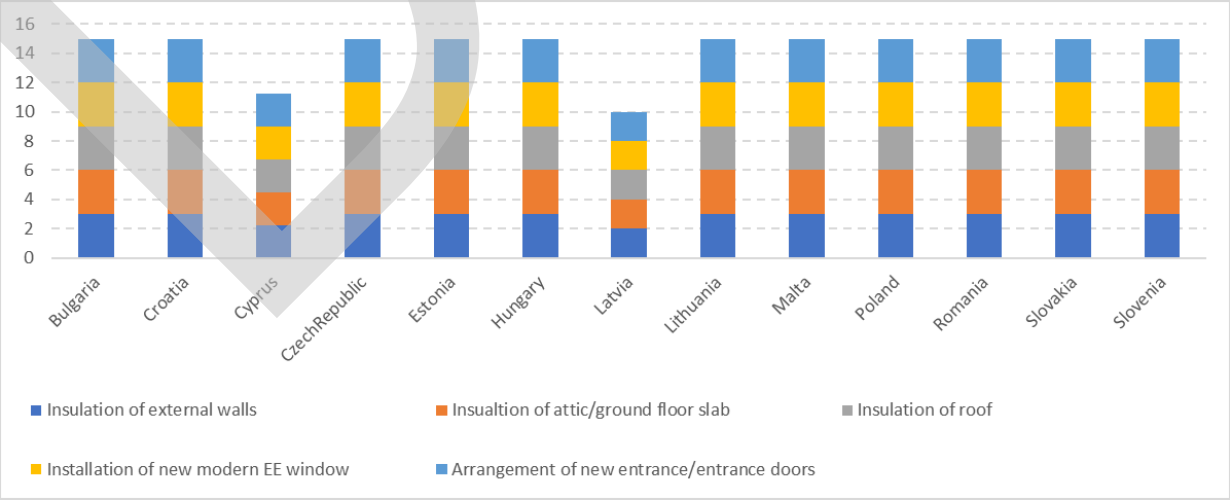

Figure 18 - New construction building envelope technology mix in subregion B.

Draft

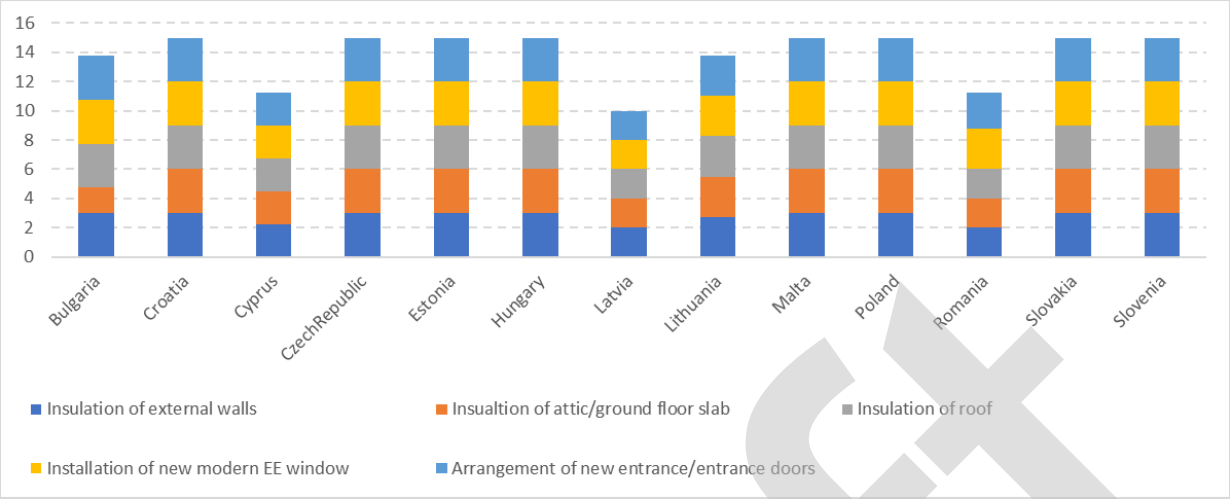

Figure 19 - Retrofits building envelope technology mix in subregion B.

In subregion B, almost all countries have made most progress in implementing effective building envelope systems for both retrofits and new construction, with the sole exception of Latvia. Some countries, such as Romania, have implemented strong support measures by way of grants and tax incentives. Since 2010, thermal rehabilitation of residential buildings was financed through bank loans that were guaranteed by the Romanian government (financing from state and local government and owners); this includes the building envelope and replacement of heating systems for low income households, along with effective audit practices. Still, renovation in existing buildings is lagging, apart from commercial buildings. Similarly, the data on Bulgaria and Cyprus show less implementation of building envelope energy efficiency technologies for commercial and public buildings; Lithuania is relatively behind in implementing retrofitting measures for single-family residences. Other countries in subregion B, such as Croatia, Cyprus, Czech Republic, Estonia, Hungary, Malta, Poland, Romania, Slovakia, and Slovenia, have achieved a remarkably fast and strong penetration of NZEB within the existing national building stocks. The data for subregion B is presented in Figure 19 and Figure 20.

In the North American subregion D, both the United States and Canada have extensive building standards – at the federal, state, and local levels – which set minimum energy efficiency requirements for the building envelope. Many US states have codes regulating building renovations as well. An analysis of relevant building standards (PNNL,2016) in the US by Pacific Northwest National Laboratory suggested that residences and commercial buildings would save over $125B between 2012 and 2040, corresponding to 841 million tons of avoided CO_2 emissions. Similar in many ways to the NZEB standard in the European Union, the US Green Building Council introduced the LEED (Leadership in Energy and Environmental Design) building rating certification program. LEED is now the most widely used green building rating system in the rest of the world; a LEED certification demonstrates that a building meets stringent energy consumption requirements.

The data analysis confirms the prior analysis of the deployment of building envelope technologies for subregions A, B, and D. Specifically, the data support the idea that the most progress in technological implementation has been made in building insulation technologies. There is a strong correlation between implementation and adherence to building codes. Table 2, an excerpt from (need paper reference), summarizes an assessment of the prevalence of energy efficient building envelope technologies.

Draft

Table 3 - Assessment of market saturation for building envelope materials.

Countries	Double-glazed low-e glass	Window films	Window attachments (e.g. shutters, shades, storm panel)	Highly insulating window (e.g. triple-glazed)	Typical insulation	Exterior insulation	Air sealing
Sub-region A - European Union (EU15), Norway and Switzerland	Mature market	Established market	Mature market	Established market	Mature market	Mature market	Mature market
Sub-region B - European Union enlargement (EU13)	Mature market	Established market	Mature market	Established market	Mature market	Mature market	Established market
Sub-region D - North America	Mature market	Established market	Established market	Initial market	Mature market	Mature market	Established market

Source: Mapping of existing energy efficiency standards and technologies in buildings in the UNECE region (p. 53).

Space Heating, Air Conditioning, Water Heating and Cooling

Figure 20 displays a visual representation of the mix of heating solutions for new construction for all countries in subregion A. For each country, the impact score has been averaged across all four building types (multi-family home, single-family home, commercial, public) for each type of technology. France has the most diverse mix of heating solutions in subregion A, followed by Spain and Ireland. Ireland is the only country in the region using coal in both new and existing buildings. With the exceptions of Greece, Italy, Luxembourg, and Portugal, all other countries in subregion A have shown improvements in developing centralized space heating solutions. Belgium, Finland, France, Ireland, Spain, and Switzerland have adopted various types of renewable energy for space heating (biomass, solar, and heat pumps). The UK, Norway, Italy, and Iceland have a higher market share in heat pumps and biomass-fired boilers. The data shows Germany uses solar energy for space heating. No evidence of substantial implementation of these technologies in Andorra was identified.

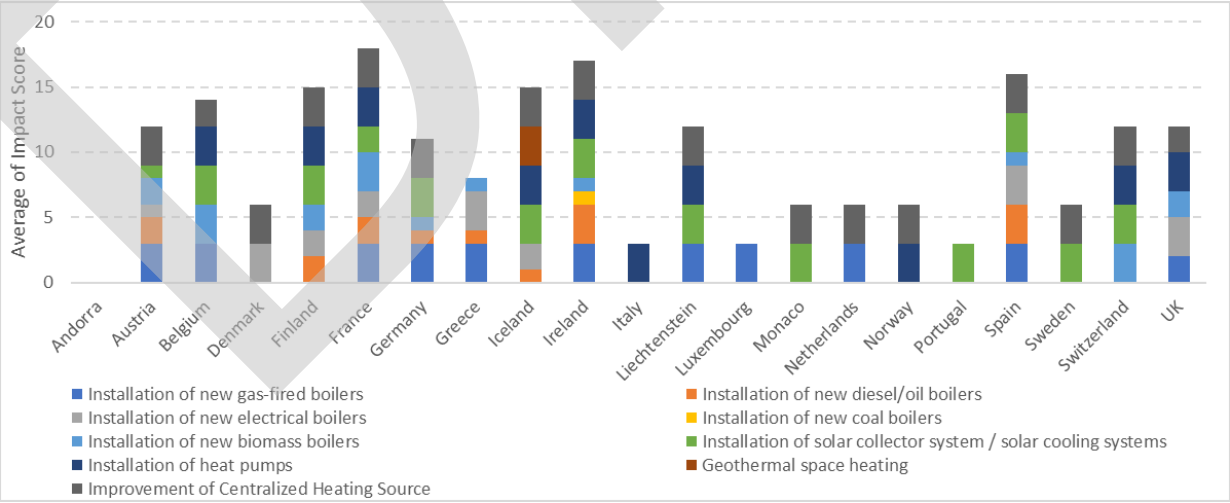

Figure 20 - New construction space heating technology mix in subregion A.

The stacked bar chart in Figure 21 shows, visually, the mix of new construction heating solutions in subregion B. Slovenia is leading the adaptation of most energy efficient technologies in space heating,

Draft

using biomass-fired boilers, solar, and heat pumps in its technology mix for new buildings and existing buildings – as are Cyprus, Malta, Poland, and Slovakia. Latvia and Hungary both have a large share of gas-fired boilers, though Hungary additionally supports adaptation of heat pumps for space heating.

Croatia and Malta have a diverse mix of space heating technologies and use diesel and oil boilers in new and existing buildings. The Czech Republic is the only country in the region to still have coal-fired boilers in new and existing buildings. Country data on Romania, Latvia, and Estonia show no market penetration of central heating systems in the buildings sector. Figure 22 summarizes this information in visual form for subregion B.

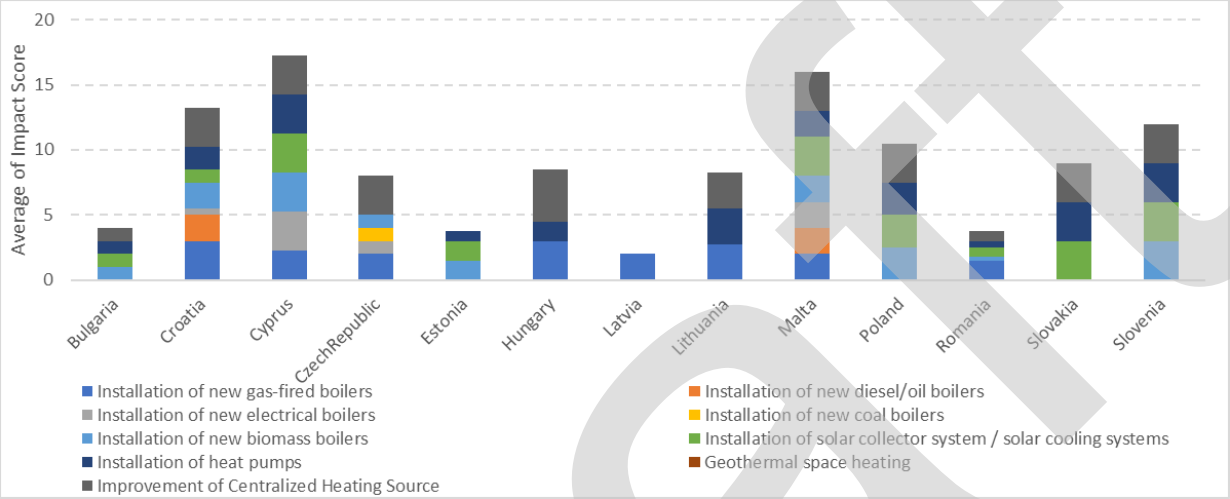

Figure 21 - New construction space heating technology mix in subregion B.

It is interesting to note that Canada in subregion D has the most diverse technologies used for space heating, including coal, with the lone exception that geo-thermal power is not used. This can be seen clearly on the Canada sheet in the annex Indeed, only Iceland in the UNECE region uses geo-thermal power for heating. The United States, on the other hand, tends to rely mostly on decentralized heating, and exhibits low adaptation of central heating systems.

Air Conditioning, Ventilation, and Cooling

After the building envelope, the second most productive area for improving energy efficiency in the buildings sector is the subsystems responsible for ventilation, space heating / cooling, and water heating / cooling. Acting to curb this energy demand and boost renewables and to reduce energy costs substantially and slash harmful carbon emissions, in 2016, the European Commission published its first plan (EC, 2016) to tackle the massive amount of energy used for heating and cooling in the buildings sector. A major strategy of the plan is to improve integration of the power grid with district heating and cooling systems, so utility-scale renewable power could replace fossil fuel generation for district heating / cooling. Figure 22 and Figure 23 show the mix of technology for new construction in subregions A and B. There are clearly substantial differences and gaps, even among countries with similar climates.

Draft

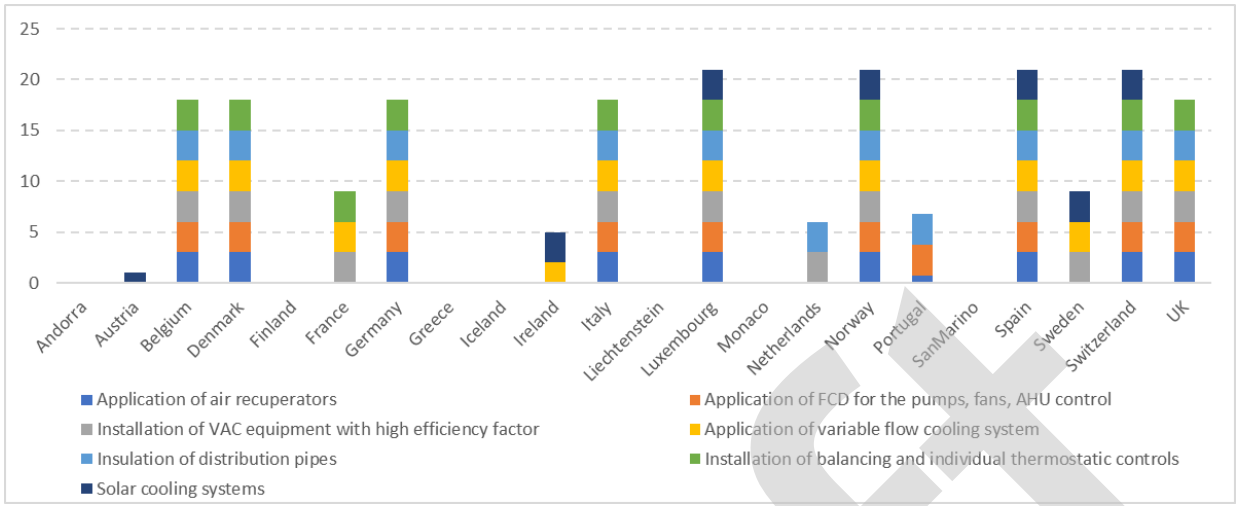

Figure 22 - New construction ventilation, air conditioning, and cooling technology mix in subregion A.

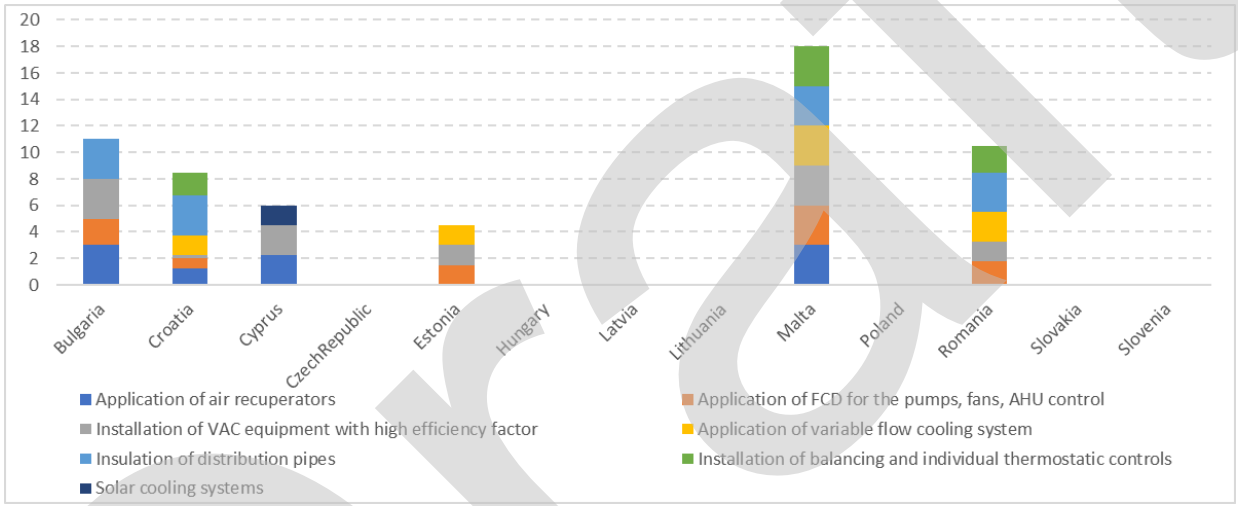

Figure 23 - New construction ventilation, air conditioning, and cooling technology mix in subregion B

There have been significant advances in the efficiency of space-conditioning equipment in recent years. A variety of fuels and technologies are used to heat residential buildings in the UNECE region. Natural gas is mainly used for heating, but the impressive gains in energy efficiency technologies in boilers, along with design improvements in vent dampers and HVAC systems, are leading to development of technological solutions which can significantly contribute towards energy savings for residential and commercial buildings. Distribution systems and controls are frequently overlooked opportunities for improving the efficiency of space conditioning systems. For example, leaky air distribution ducts can result in significant energy losses, suggesting that greater attention to such simple parts is warranted. Existing building retrofits improve the efficiency of space heating systems already in place, and are usually limited to simple maintenance, such as replacing filters, oiling motors, and cleaning burners.

Draft

One strategy used in Sweden (subregion A) to improve the efficiency of space conditioning is to link district heating systems with industries. In some parts of Sweden (SSB, 2011), a significant proportion (up to 90%) of multi-family residential buildings rely upon district heating that uses waste heat from nearby industrial plants and waste incinerators. Not only does this reduce energy consumption for space heating, but it also reduces industrial waste heat. Finland (subregion A) is another useful example. It is one of the leading countries in the world in the utilization of combined heat-and-power generation. More than 30% of the country's electricity is generated in connection with the production of district heat. Almost half of the population lives in residences warmed by district heating.

The three subregions A, B, and D have significantly progressed in deploying energy efficiency technologies for heating and cooling. The market and policy makers are pushing the uptake of technology in the building sector; this is demonstrated in Table 4.

Table 4 – Assessment of market saturation of heating, cooling and other EE technologies.

Countries	Condensing boilers	Biomass boilers (wood chip and pellet)	Pellet stoves	Heat pumps	Solar thermal systems	PV systems	Other
Sub-region A - European Union (EU15), Norway and Switzerland							
France	X	X	X	X	X	X	
Germany	X	X	X	X	X	X	
Italy	X	X	X	X	X	X	
Portugal	X	X	X	X	X	X	Cogeneration, trigeneration, district heating and cooling
Switzerland	X	X	X	X	X	X	
Spain	X	X	X	X	X	X	
United Kingdom	X	X	X	X	X	X	
Sub-region B - European Union enlargement (EU13)							
Bulgaria	X	X	X	X	X	X	
Croatia	X	X	X	X	X	X	
Czech Republic	X	X	X	X	X	X	Forced ventilati with heat recovery, heat recovery
Slovakia	X	X	X	X	X	X	Combined Heat and Power
Sub-region D - North America							
Canada	X	X	X	X	X	X	
United States of America	X	X	X	X	X	X	

Source: Mapping of existing energy efficiency standards and technologies in buildings in the UNECE region (p.56).

Appliances

Throughout the lifetime of a building, equipment such as appliances, lighting, and electronics is replaced and upgraded. Each time this occurs represents an opportunity to maximize efficiency improvements. Such upgrade opportunities are much more frequent than major retrofits — appliances are replaced several times over the life of a building; electronics and lighting even more often. Each replacement decision has less energy impact than a retrofit, but the aggregate impact is

Draft

of nearly comparable importance. The primary tool used by policymakers to encourage uptake of energy efficiency in both household and office appliances has been through labeling, though some governments have implemented cash rebate programmes.

In the USA, the American Recovery and Reinvestment Act (DOE, 2015) has resulted in an unprecedented number of household appliances being replaced with energy efficient upgrades. Other countries with similar programs include Canada, Denmark, and Germany. EU member States are bound by the 2010 EU Energy Labeling Directive (2010/30/EU) and previously-mentioned Ecodesign Directive. These directives require many household appliances to meet minimum energy efficiency standards and to carry energy labels, categorizing the expected energy consumption (similar to the voluntary Energy Star program introduced by the US Environmental Protection Agency). However, obtaining the maximal impact of appliance labeling programs requires promotion on the part of EU member State governments; the case of Latvia is instructive of this point. Latvia, for example, has failed to realize the expected increased energy efficiency in appliances, as there has been insufficient promotion of labeled products.

Overall, the low-hanging fruits of improved energy efficiency in appliances has probably already been picked; large appliances - such as refrigerators, freezers, and washers - are substantially more efficient than their 1990's counterparts.

A second issue with labeling is the stringency of the efficiency requirements – specifically when minimum requirements are equal, or very close, to the market averages. More stringent regulations that drive technological innovation are needed to induce market changes and improve energy efficiency.

Lighting

The energy efficiency of building lighting can be improved by the application of three main types of technological solutions:

- application of daylighting architectural solutions
- installation of interior & exterior lighting sensors and controls
- installation of newer light bulbs (CF & LED)

Policymakers predominantly use legal constraints, such as building codes and technological standards, and informational programs to drive improvements in lighting energy efficiency. Many countries have phased out inefficient lighting technologies by tightening efficiency standards. Building codes also place requirements on lighting fixtures and control systems to encourage efficiency. While enhanced standards have a big effect, they mostly impact new construction (and buildings undergoing deep retrofits, to a lesser degree). For example, daylighting architectural solutions, which involve designing a building to make maximal use of sunlight for internal lighting, can obviously mostly be applied to new construction. Policymakers from Finland, Denmark, Monaco, and Norway (subregion A) have been effective in encouraging the use of this technology in both new and existing buildings. Figure 24 presents the data on lighting technologies in new construction for subregion A. It is moderately prevalent in Austria, but only for public buildings. In subregion B, only Estonia and Cyprus make much use of daylighting, with Estonia also focusing on public and commercial buildings. In addition to reducing energy consumption, there are documented social benefits to using natural lighting.

Draft

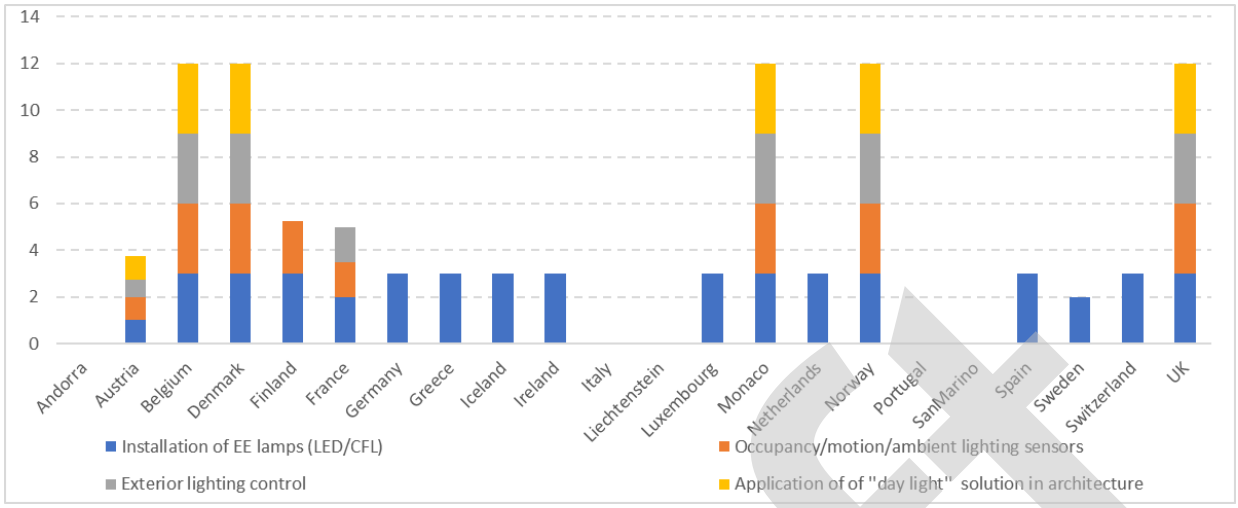

Figure 24 - New construction Lighting technology mix in subregion A.

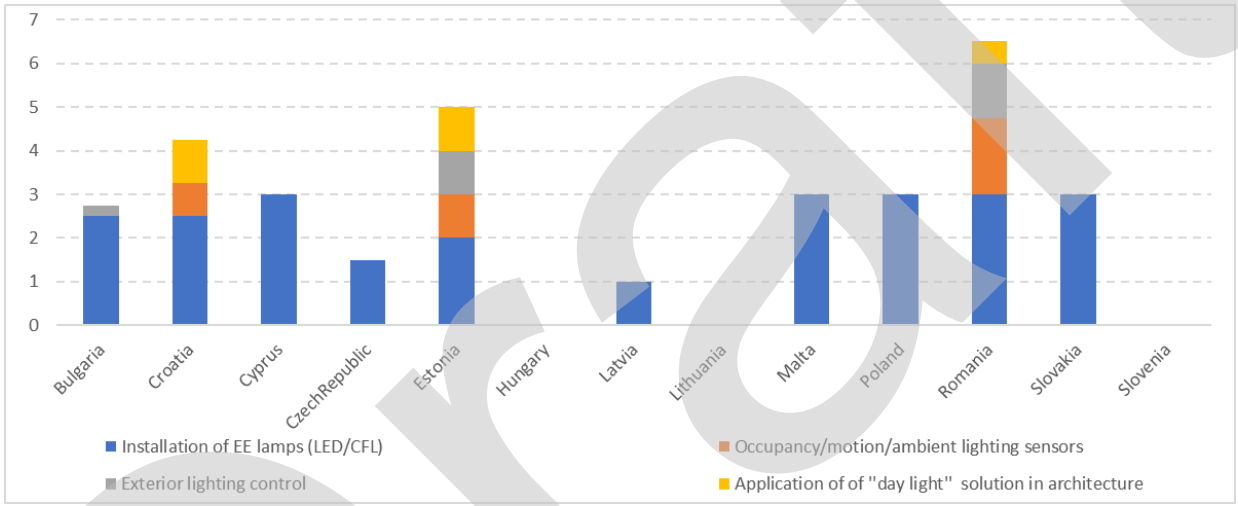

Figure 25 - New construction Lighting technology mix in subregion B.

In 2013, energy saving initiative undertaken by then the Environment Minister, Delphine Batho required all non-residential buildings in France to turn off the lights at night to reduce both light pollution and energy consumption. Indoor lighting which can be seen from outside must be switched off at 1 AM or one hour after closing time (whichever is earlier) and can only be switched-on after 7 AM or one hour before opening (whichever is earlier). Outdoor lighting of building facades (shops, monuments, schools, city halls etc.) can only be on between sunset and 1 AM. Sensor-based control systems have the potential to support and enable initiatives such as this.

Lighting sensors and controls are technologies that can have a tremendous impact on energy consumption for lighting – both interior and exterior - by ensuring that lights are only used when required. The economic attractiveness of sensor-based lighting controls is building specific, depending on factors such as operational hours, occupant behavior, electricity prices, etc. It is nearly inconceivable, that the appropriate application of lighting sensors and control technology could not reduce energy consumption and pay for itself.

Draft

Despite the disproportionately large impact on reducing building energy consumption, sensor-based lighting controls are not widely used. Only Cyprus and Estonia, in subregion B, make moderate-to-heavy use of the technology, as can be seen in Figure 25. The technology is significantly prevalent in less than half of the subregion A countries. Hence, it is clear that public policy and awareness campaigns are necessary to encourage adoption.

The simplest, furthest reaching, and most prevalent technology for decreasing lighting energy consumption is energy efficient light bulbs. Compact fluorescent (CF) bulbs and light-emitting diodes (LED) are far superior to both incandescent and halogen bulbs. New energy efficient light bulbs can be used in both new and existing buildings, residences, public buildings, and commercial buildings.

The United States began phasing out incandescent bulbs in 2007, and the Canadian government began banning them in 2014. The European Union voted in 2009 to ban them, with the ban taking full effect September of 2018. In the EU, the incandescent ban is expected to reduce annual energy consumption by 9.4 TWh - equivalent to Portugal's electricity consumption over 5 years. These savings correspond to a reduction of 3.4 million tonnes of CO_2 emissions every year, as well as a significant reduction in waste. However, simply banning incandescent bulbs is not enough, as has been seen by some of the earliest adopters.

The UN member States which implemented relevant policy earliest – such as Denmark and the United Kingdom – have seen sharp reductions in sales of incandescent bulbs, as expected. However, much of this market share has inadvertently been shifted to halogen bulbs. Halogen bulbs are only slightly more efficient, so the full potential for energy savings that could be achieved through switching to CF bulbs or LEDs has not been realized; there is little sign of LEDs having significantly penetrated the domestic lighting markets yet.

In subregion A, most countries are relying solely on energy-efficient lamp replacements to drive reductions in energy consumption for lighting – countries like Germany, Spain, and Switzerland. A few countries are much more diversified, investing in efforts to use all three types of technological solutions. Denmark, Monaco, and Norway exemplify this strategy of diversification. In subregion B, Estonia is diversifying efforts for new construction, with Cyprus focusing on retrofits.

Smart Systems and Solutions

The UK Government is committed to ensure that every home and small business in the country is offered a smart meter by the end of 2020. Their Smart Metering Programme (DBEIS, 2018) aims to roll-out over 50 million smart meters (gas and electricity) to all domestic properties and smart / advanced meters to smaller non-domestic sites in Great Britain - impacting approximately 30 million premises. The Smart Metering Programme is currently in the main installation phase, and there are now over 11 million smart and advanced meters operating across British homes and businesses.

There are several types of energy efficient technologies that have the potential to impact multiple building subsystems. A good example of technology that enables increased energy efficiency in several different building subsystems is smart metering and smart building systems. In fact, one of the primary objectives of EU energy efficiency directives is to encourage the use of information and communication technology and smart technologies to ensure buildings operate efficiently. The governments of Denmark, Italy,

Draft

Switzerland, and the United Kingdom in subregion A, and Estonia, Lithuania, and Malta in subregion B have implemented energy efficiency policies promoting the application of such smart systems. In fact, nearly 100% of buildings in Finland, Italy and Sweden are already equipped with smart meters.

In the United States, cloud-based energy management and control systems are extensively used as they obviate the need for on-site staff with expertise in maintaining the building energy systems. Using a third-party firm to monitor the building, for instance checking HVAC equipment or setting lighting schedules, can be a cost-effective way to reduce energy consumption. However, for a multi-tenant office building, split incentives may discourage a building owner from purchasing a cloud-based control system when tenants are responsible for their energy consumption. However, for office buildings in which the owner is responsible for paying the energy bill and maintaining the building's primary energy consuming systems, there is more economic incentive to invest in such technology. This suggests that the highest barrier in implementing smart metering and control systems technologies in buildings is the requisite capital expenditure - which most countries believe is the key issue.

Draft

Subregions C, E and F

Building envelope: insulation and glazing

Countries of subregions C and partly E have similar post-Soviet type of building construction. Most of the existing residential and public buildings were designed and constructed almost 30-50 years ago. Policies and norms of the 1970s and 1980s were stricter in terms of construction materials quality and envelope safety level, but with less emphasis on energy efficiency requirements such as insulation and glazing. There is an extensive requirement for retrofit programs to improve insulation and glazing for existing buildings.

Most of the countries in subregions C, E, and F updated their building codes for insulation and glazing in both new construction and retrofits by 2018. Most of the countries have made it mandatory to install insulation and glazing right from the design stage. Requirements for retrofits is different, and in most cases, require additional external financing and modification of procurement procedures for public and multi-family residential buildings. The technology mix of existing buildings envelope in subregions C, E, and F is presented in Figure 26 below.

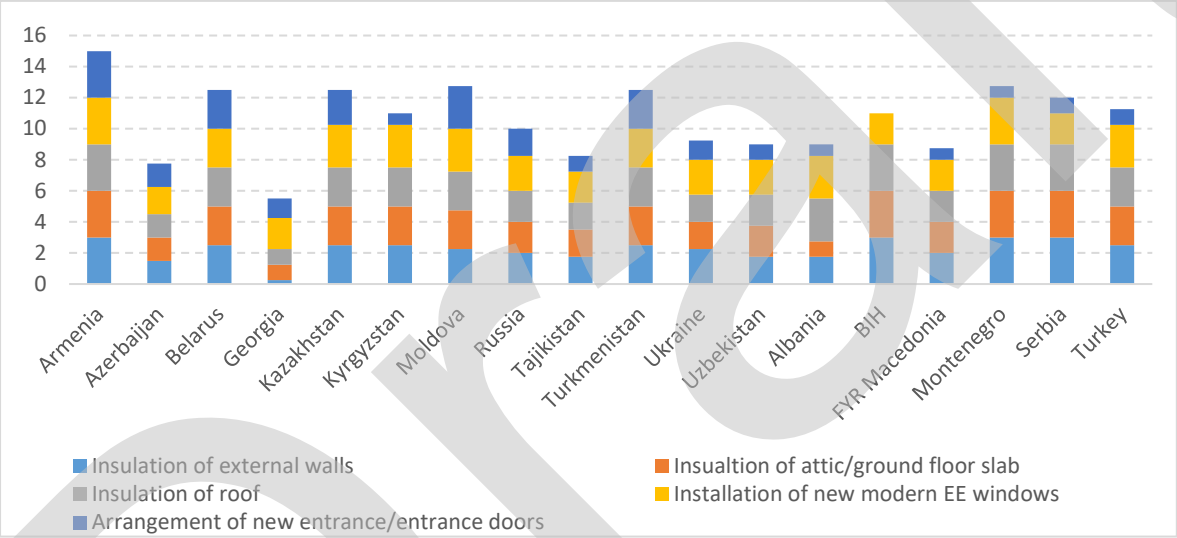

Figure 26 – Technology mix of existing buildings envelope modernisation in subregion C, E, and F.

Draft

Countries of subregions E and F (Serbia, Albania, Montenegro, less in Turkey) are working towards decreasing imports of fuel for domestic energy consumption, by investing in renewable energy sources and bioenergy, in order to become more sustainable and self-sufficient. In 2018, a pilot implementation of these projects was undertaken in countries of subregion E, predominantly, with the operations schemes subsidised by the government or international donors.

There is a common approach in almost all countries of subregion C to include typical energy efficient measures, like modern insulation and glazing, for retrofits and new construction for multi-family residential and public buildings. These requirements are reflected in country-specific laws on energy efficiency (or equivalent). In most cases proper insulation and glazing are considered to be a measure with a long-term payback period, especially taking into account lower energy prices, such as in subregion C. However, most countries do understand the importance of insulation and glazing for sustainable development of buildings. There are different support mechanisms made available for various building types. For multi-family residential and public buildings, there are incentive mechanisms provided by the government to eliminate this financial gap (subsidized loans, tax incentives, specialized energy efficiency funds, where insulation and glazing are priority measures). Public buildings are usually financed from the state, regional or municipal budgets have a special internal policy or norm which includes mandatory implementation of energy efficient insulation and glazing for both new construction and retrofits. In Kazakhstan, Armenia, Ukraine, the Russian Federation, and some other countries in subregion C, E, and F, there is a requirement to perform a pre-defined amount of annual insulation and glazing projects for public and multi-family residential buildings, which are included in the financing budget of relevant departments (or municipalities).

Armenia is a leader among all countries of the subregions. In 2018 the country transposed EU Directive on the energy performance of buildings, and harmonized it with local construction and design standards. This resulted in enforcement of mandatory energy efficiency requirements for all building types, and improved technology penetration with an important role of local manufacturers of insulation materials.

Commercial buildings have less specified mandatory requirements for insulation and glazing in various regulations across all countries of subregions C, E, and F. In most cases it is a market driven process supported by business owners. Analysis of the insulation technology mix for existing buildings shows a good level of insulation and glazing technologies implementation, except for the arrangement of new entrance doors in all countries besides Armenia, Moldova, Kazakhstan, and Turkmenistan. This issue can be fixed by improvement of local legislation and public procurement requirements, in order to cut energy and financial losses. It is especially relevant for countries of subregion E with higher energy prices, and countries of subregions C and F which have cold climates.

Single-family residences still have lower levels of energy efficient insulation and glazing implementation. By 2018, as a result of numerous awareness raising campaigns supported by local governments and international organizations across all the countries of subregions C, E, and F, there was an obvious shift in understanding of the potential for savings by individual home owners[7]. For example, special micro-finance tools were developed and implemented in 2012 by the Asian Credit Fund in Kazakhstan and Kyrgyzstan to support citizens of rural areas to improve quality of their houses. In Uzbekistan there are programmes for new construction of standardized energy efficient individual houses supported by the government. These programmes offer subsidized price and mortgage schemes. A similar approach is implemented in Armenia.

[7] http://www.eurasia.undp.org/content/rbec/en/home/presscenter.html

Draft

Space Heating, Air Conditioning, Water Heating and Cooling

Modern technologies in space heating, and domestic hot and cold water supply show various levels of fuel mix used across countries of subregions C, E, and F for each technology. Some coal mining countries of subregion C, like Kazakhstan, still actively use coal for electrical and heat energy generation, from large CHPs to small-scale boilers, and this trend appears likely to continue while coal is in cheap supply. In this case it is better to concentrate on promotion of eco-friendly coal burning technologies, rather than to completely ban the use of coal.

Improvement of Decentralized Heating Source

The technology mix for improvements of decentralized heating source of existing buildings in subregions C, E, and F is presented in Figure 27 below. Subregion C includes a number of coal mining and consuming countries, where the decentralised heat supply and power generation are mainly based on coal. Modern energy efficient coal-burning technologies have medium or low levels of use. By 2018, some coal consuming countries of subregion C demonstrated interest in investing in new energy efficient technologies for using coal. Pilot implementations of high efficiency boilers and pyrolysis-type back-pressure steam turbine energy generators in the Russian Federation and Kazakhstan show substantial technical and financial potential for cleaner energy generation from fossil fuels or municipal waste[8].

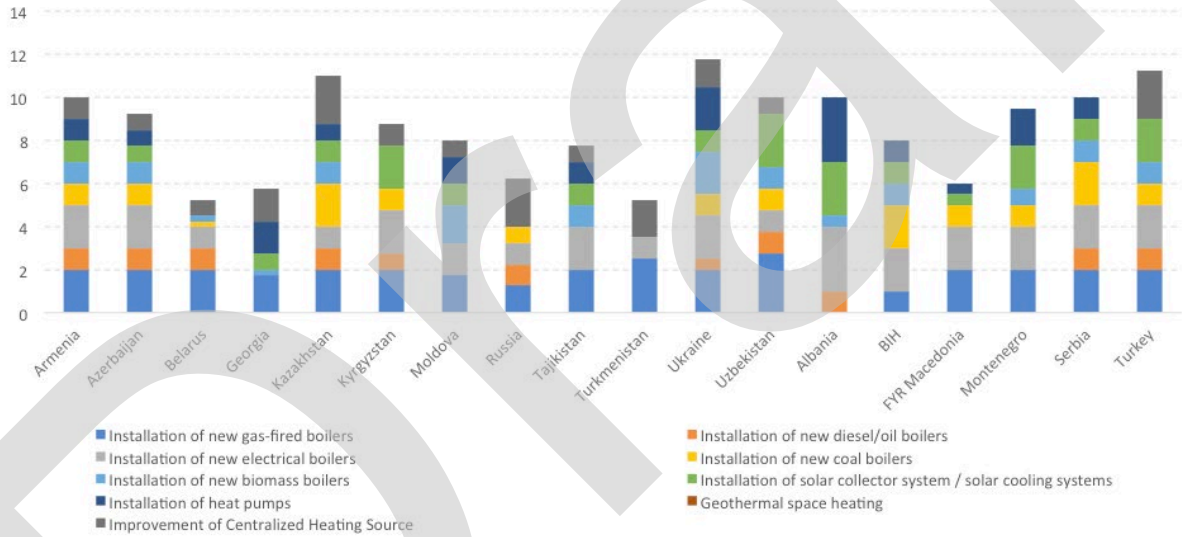

Figure 27 - Technology mix of improvements of decentralized heating sources for existing buildings in subregions C, E, and F.

Implementation of biomass-fired boilers is still in a development stage for most of the countries, with slightly better implementation in Ukraine and Moldova from subregion C, and Serbia, and Bosnia and Herzegovina in sub-region E.

Installations of new energy efficient gas-fired boilers are mandatory in Turkmenistan and Uzbekistan for all building categories. Other countries show better implementation levels for building retrofits and new construction of multi-family and public buildings, with lower levels of implementation for other building types. Based on the analysis of collected data, it is fair to conclude the availability and high level of modern gas-fired heat and energy generators produced by both worldwide companies and local manufacturers, across countries of subregions C, E, and F. Most of the countries of Central Asia in subregion C with low population density have low stock availability of spare parts in case

[8] http://rpn.gov.ru/sites/all/files/users/rpnglavred/filebrowser/docs/doklad_po_tbo.pdf

Draft

repairs are needed; that means that sometimes there are limited options for selecting a technology in the local market (municipal level) without reference to energy efficiency factors. Another barrier for higher penetration of these technologies is limited to the level of professionalism and competence of local maintenance specialists.

The owners of commercial buildings in most of the countries of subregions C, E, and F have clear understanding of benefits of modern energy efficient generation equipment used in commercial buildings such as shopping malls, hotels, and office, because it helps reduce energy bills.

Some countries in subregions C, E, and F have adopted advanced mandatory requirements for implementation of heat pumps (Albania and Ukraine), and solar collector hot water systems (Uzbekistan and Kyrgyzstan). National agencies as well as international donor organizations launched a series of renewables-focused projects in the buildings sector in order to stimulate the dissemination of these technologies.

More than half of the countries use electrical boilers across various building types of subregions C, E, and F because there is a lack of other fuel sources available for heating and domestic hot water preparation. In such cases, it is required to have a deep focus on installation of new efficient electrical energy generation units, with properly-adjusted waste heat recovery schemes, in order to increase total electricity generation efficiency values. Nevertheless, no countries were identified with governmentally supported mandatory requirements for installation of energy efficient electrical boilers. This is a serious gap that should be eliminated in the near future, due to the absence, in most cases, of reasonable rapid alternative fuel.

Common Measures and Improvement of Centralized Heating System

Subregions C and E have a long history of centralised heat supply system implementation. Equipment that is currently in operation in countries of subregion C was principally designed and installed in the 1960s – 1970s, and already became the object of a large-scale renovation campaign powered by a number of national policies, as well as region-specific incentives and relevant financial tools. Improvement of centralized heating systems is a critical issue for most of the big cities in countries of subregions C and E.

Figure 28 presents the technology mix in subregions C, E, and F for common measures and improvement of centralized heating systems in new construction.

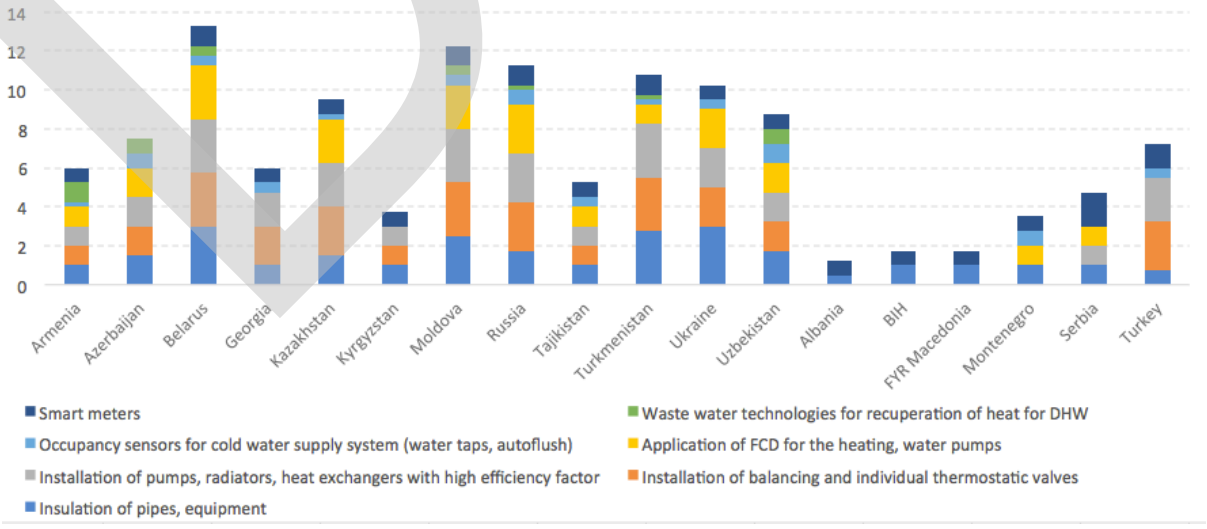

Draft

Figure 28 - Common measures for heating system for new construction technology mix in subregions C, E, and F.

The chart shows that the most popular technical solution used in each country of subregions C, E, and F is the installation of individual heat points with weather compensation control.
There are some countries, such as the Russian Federation, Kazakhstan, Turkey, and Ukraine, with mandatory requirements for implementation of this measure both for retrofits and new construction of all types of buildings except for single-family buildings. Other countries with existing centralised district hot water supply systems are in the process of adoption or implementation of this technology. Countries which are not focused on support of this activity are Albania, Bosnia and Herzegovina, Macedonia, Montenegro, Belarus, and Uzbekistan.

Common measures are widely implemented across all countries of subregions C, E, and F. Insulation of pipes and other equipment solutions are mandatory in Ukraine, Moldova, Turkmenistan, and Belarus. Despite the importance of pipe insulation, several countries have very low levels of implementation: Kyrgyzstan, Armenia, Turkey, Georgia, Montenegro, and Serbia. These gaps are tracked by governmental discussions in these countries, and should be resolved in the nearest future.

Some countries of subregions C, E, and F (the Russian Federation, Turkey, Moldova, Ukraine, Turkmenistan, Belarus) have already added installation of balancing valves, thermostats, efficient pumps, heat exchangers, and other relevant engineering equipment into the mandatory country policies and design norms.

Other technologies from the list of common measures, e.g. energy efficient water pumps, water supply sensors, and wastewater heat recuperation, are still implemented at low or medium levels for most of the multi/single family residential and public buildings in countries of subregions C, E, and F. Some pilot projects on heat recuperation and recovery for buildings sector were implemented by national agencies in the Russian Federation, Belarus, Kyrgyzstan, Uzbekistan, and Turkey with the support of international organizations. Local financial institutions should have bigger focus in awareness raising and transparent financing schemes with better support from municipal level administrations. This is especially true for public buildings.

Ventilation, Air Conditioning and Cooling

Research for this study identified a trend showing that most of the countries are focused mainly on ventilation and air conditioning for predominantly newly constructed building. From the technical point of view, there are limitations in VAC equipment installation and modernisation during the retrofit of multi-family residential buildings; due in most cases to limited indoor space and the absence of VAC system design in the original construction. Implementation is higher, however, for retrofit of other building types, as well as for new construction.

Installation of air recuperation units and modern FCD solutions for fans and pumps is common for the new construction of commercial and public buildings. This trend can be seen in Ukraine, Moldova, and the Russian Federation, where these technologies are mandatory and show high implementation levels. Figure 29 presents existing gaps in ventilation, air conditioning and cooling technologies implementation for existing buildings in subregions C, E, and F.

Draft

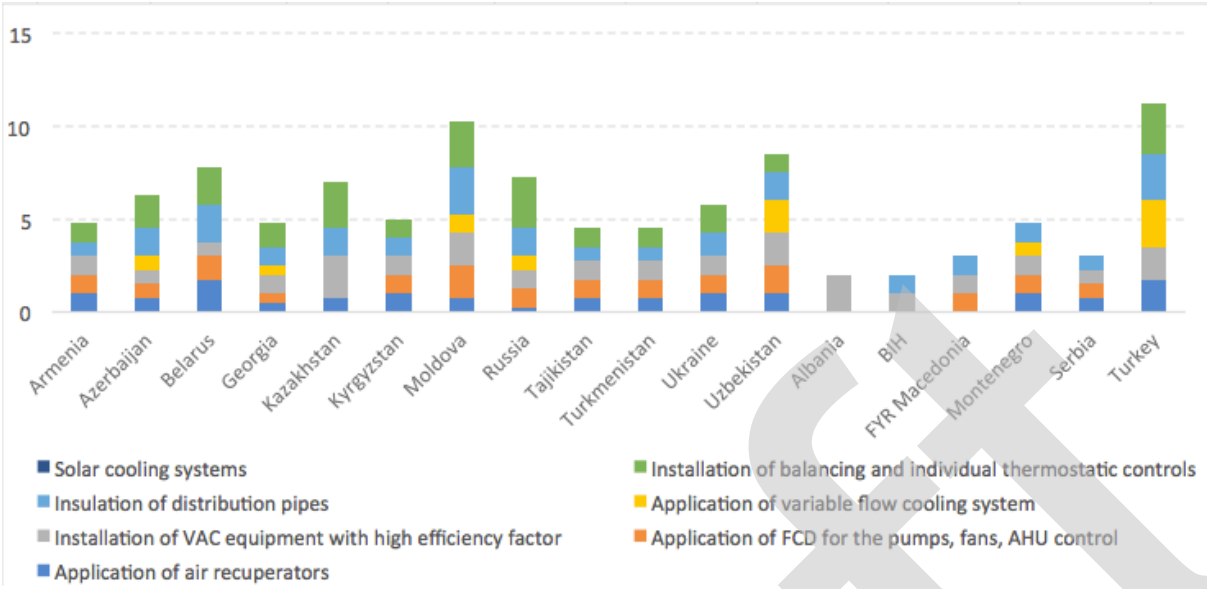

Figure 29 - Ventilation, air conditioning and cooling technologies mix for existing buildings in subregion C, E, and F.

Analysis shows that countries of subregion E and F still have certain gaps in implementation of energy efficient technologies for VAC systems. However, these issues should soon be resolved by implementing strict mandatory requirements from EU Directives, which are currently being transposed into national laws. Turkey shows a high penetration rate of modern VAC equipment even for the retrofit of existing buildings stock. Climatic conditions, favourable trade channels and location, and product availability, as well as strong governmental support, resulted in a high level of technology penetration. National and international banks in Turkey are very active in promotion of various packaged "Energy efficient home" solutions[9].

Implementation of variable flow cooling systems across countries in subregion C is a relatively new trend, which shows high potential for increasing energy efficiency in the buildings sector. The technology is mostly used in retrofits and new construction of commercial and public buildings in Turkey, Georgia, Moldova, and Montenegro. Variable flow cooling systems are implemented less frequently in multi-family residences in all countries.

Promotion and implementation of modern absorption-type cooling units and effective individual air conditioners is supported by a number of international and national stakeholders operating in countries of subregions C, E, and F. For the Russian Federation, Uzbekistan, Turkey, and Ukraine, the technology is either mandatory or currently at high level of implementation for both retrofits and new construction of all building types except commercial buildings[10].

Appliances

[9] http://www.tr.undp.org/content/turkey/en/home/sustainable-development-goals/goal-7-affordable-and-clean-energy.html
[10] https://minenergo.gov.ru/node/6034

Draft

Promotion of energy efficient appliances use is a relatively new trend for countries of subregion C. Nevertheless, building energy load profile analyses have demonstrated that implementation of modern appliances (household and especially commercial) could bring large energy savings to the overall energy consumption pattern of a typical building. By 2018 the Russian Federation, Kazakhstan and Turkey have promoted the implementation of energy efficient appliances with support of international donors, conducting campaigns to raise awareness, covering both public and private sector representatives.

Across subregion C, there is certain level of understanding of energy efficient appliances benefits and there is market demand for highly efficient household appliances for multi-family residential, and single-family buildings. Unfortunately, most appliance suppliers in the countries try to obtain a marketing advantage on better promotion by naming the equipment as more efficient, rather than really focusing on reduced energy consumption parameters, which works for uninformed customers.

Awareness campaigns, aimed at promoting energy efficient appliances, have taken place in almost all countries of subregions C, E, and F. The Russian Federation, Kazakhstan, and Kyrgyzstan launched a joint information campaign "Together Brighter"[1] in 2017, supported by the Ministries of Energy from each country. Energy efficient appliances implementation and green energy living standards are also promoted during annual "Energy Efficiency Day", which usually takes place in all three countries in the beginning of September.

For public and commercial buildings, implementation of modern efficient appliances became a common norm in the last 5-6 years, mainly because of increasing energy prices. Most of the countries of subregions C, E, and F adjusted their public procurement procedures for both new construction and retrofit processes, with strong requirement to purchase only high efficiency class equipment.

Countries of subregions E and F are following the general European approach to mandatory implementation of energy efficient appliances for all building types. Only a few countries, such as Turkmenistan (in subregion C) and Bosnia and Herzegovina (in subregion E), still have not made energy efficient appliances mandatory, but they are making progress.

Insulation of distribution pipes for cooling networks is widely implemented in almost half of the subregion C and F countries (Turkey, Uzbekistan, the Russian Federation, Azerbaijan, Moldova, Ukraine, and Belarus). Governmental support and other investments into this measure increased during the last 5-6 years and resulted in the cooling equipment market growth, with active presence of modern efficient equipment suppliers. In order to ensure proper functioning of the new equipment, detailed attention was focused on increased quality of insulation.

Lighting

A global trend towards modern energy efficient lighting system implementation in full scale is seen across all the countries of subregion C, E, and F. Implementation of energy efficient lighting systems has been strongly promoted. The national governments, together with various international donors, provided massive support for improving capacity of local producers, with a focus on developing, in most cases, modern LED technologies. It is

Draft

interesting to mention that new construction design norms and practices were seriously modified towards mandatory implementation of efficient LED and CFL lamps, with an official ban of production and distribution of old type incandescent lamps. Figure 30 presents the application of lighting technologies in subregions C, E, and F, for new construction.

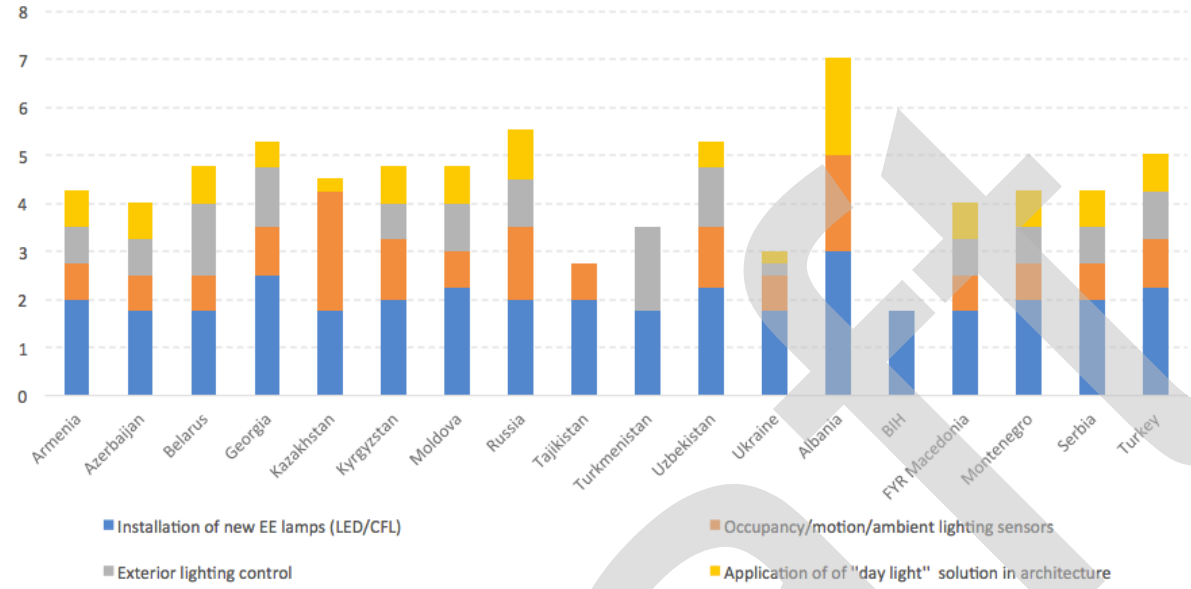

Figure 30 – Application of lighting technologies in subregions C, E, and F, for new construction.

This study identified no cases of mandatory implementation of LED lamps in policy in subregions C, E, and F; nevertheless, there is certainly a positive trend of installation for all the countries. The highest levels of penetration are for capital repairs and new construction of all building types except for single-family residences. In addition, there are some countries focused on further promotion of occupancy/daylight sensors, exterior light control, and daylight architectural solutions. At the moment, almost all countries still have low levels of implementation of these technologies. Nevertheless Albania, Kazakhstan and the Russian Federation strongly support implementation of various light sensors (occupancy, motion, ambient light) in order to reduce expected expenses for the common premises of multi-family residential buildings (stairwells, entrance halls, etc.). Promotion and change of procurement procedures for the implementation of energy efficient lighting for residential and public buildings with governmental support resulted in growing market interest in ESCO-financing of such projects[11].

Smart Systems and Solutions

The primary objectives of smart solution measures and metering systems are tracking and verification of energy consumption. Without an established metering system and officially approved control methodology, it is difficult to conduct fair calculation of achieved energy efficiency, forecast estimated energy consumption profile and energy savings potential in the future. One of the biggest gaps in terms of implementation of smart solutions in countries of subregions C, E, and F is the lack of legislative acts, which are focused on regulation of methodologies for the analysis of energy efficiency results and savings potential. This means that solely massive implementation of smart meters and data collection systems would be redundant and provide little value, without properly-developed analytical methodology adopted on a relevant national level.

[11] http://www.rs.undp.org/content/serbia/en/home/ourwork/environmentandenergy/energy/removing-barriers-to-promote-and-support-energy-management-syste.html

Draft

In 2015, Serbia[1] started a national energy management program of massive connection of public buildings to a centralized database used specifically by national authorities and municipalities for budget planning and energy consumption forecast. This experience is now being transferred across subregion E to Bosnia and Herzegovina and Albania. In subregion C, the Russian Federation and Kazakhstan are among the leaders in energy management smart systems implementation. The Russian Energy Agency has operated since 2012 the State Energy Information System, which incorporates all energy consumption data from multi-family, commercial, and public buildings. Originally it was developed for manual data input, but during the last 2-3 years it significantly migrated towards digitalization and smart data collection of energy data.

Having a strong administrative and analytical approach to smart solutions shows good results in Serbia and Bosnia and Herzegovina, (subregion E), Ukraine, Kazakhstan, Armenia, Russian Federation (subregion C), and Turkey (subregion F). Implementation, supported by the government, of municipal level energy management systems, in these countries resulted in high quality increases of energy action plans for municipalities, which used such an approach. This is especially true for multi-family residential and public buildings.

In 2012, Kazakhstan became the first country in the non-European region, to introduce a strict mandatory requirement for nomination of responsible municipal energy managers with relevant smart data collection system implementation for objects consuming over 1,500 TOE annually. This approach continued until 2016, when the mandatory requirement was excluded from the law and the positions of energy managers were no longer financed by the state budget. This resulted in an immediate freeze of all energy management activities. This example confirms the benefits and efficiency of systematic approach – but only with the strong support of the national government. This is especially true if relevant administrative positions are created and financed as new roles, rather than increasing duties and responsibilities of the existing personnel.

Draft

CONCLUSIONS AND RECOMMENDATIONS

The broad findings throughout the UNECE subregions analysed are:

1. Analysis based on the data collected shows overall positive trends in energy efficiency in the buildings sector in all the regions. Even countries of subregions C, E, and F, which traditionally have low internal energy prices, have significantly increased mandatory energy efficiency requirements, especially for the newly constructed buildings. Having said that, energy efficiency in the buildings sector is improving only incrementally and in disjoint fragments.
2. This study highlights three types of public policy tools, which support energy efficiency improvements in buildings, as successful practice: legal regulations (such as building standards), financial incentives (rebates, reduced-rate debt, tax deductions), and information awareness programmes for various types of energy efficient technologies (building envelope, glazing, HVAC systems and others).
3. Positive correlations between existence, scope and stringency of building standards and application of energy efficient technologies and their diverse mix have been identified.
4. In addition to the numerous environmental benefits associated with decreased energy consumption and increased generation of renewable electricity, many of the technologies discussed in this report offer other non-energy related social benefits.

In this section, conclusions are drawn from the analysis and presented along with recommendations, this will allow readers to effectively assimilate the analysis and results discussed in this report.

<u>Policy and legislation</u>

1. In buildings, space conditioning is the largest source of fuel consumption across all warm and hot climate UNECE countries. The initiatives taken in subregions A, B, and D are causing a paradigm shift in adoption of technologies for heating and cooling. The analysis of subregions A and B (EU countries) shows increased adoption of highly efficient boilers, along with shifts to cleaner fuel sources. The trend is predominantly moving towards efficient gas-fired boilers, electric boilers, solar collector systems, and heat pumps. This is likely due to the market reacting to relevant EU directives, which also target technologies in building insulation and windows.

Recommendation A: *Governments need to provide good policy, strong institutions, and efficient public services to ensure the private sector can thrive; they must also commit to develop and sustain the institutions that implement, oversee, and regulate these policies*. The technological developments discussed in this report can: boost economic growth, develop local competitive markets, increase employment, promote implementation of lower-cost and accessible energy efficient technologies, and develop international markets. Government plays a central role in supporting economic growth and creating the enabling environment that encourages the private sector to invest. The private sector is critical to economic growth, but it cannot and does not act alone, a balanced strategy is required; an example is the "Technology push and Market pull strategy".

Recommendation B: *Governmental research and development programs should be designed to advance technologies which are too risky for the private sector*. This will require transparent collaboration between government, industry, and energy program administration. Some of these innovations will eventually mature to a point that the private sector can develop them into marketable products.

Recommendation C: *More specific requirements to better define cooling degree-days should be included in energy efficiency standards in buildings*. Most design and construction norms in countries of subregions C, E, and F currently have clear definitions of the implementation of heating systems,

Draft

and capacity calculations, but cooling degree degree-days are not factored into the standards. This may have a substantial impact in countries with warm and hot climates. Energy performance certificates define specific energy consumption expectations for electrical and heating equipment, without clearly defining the impact of heating - and especially cooling - systems. Countries should introduce more specific definitions of cooling degree-days for each building type to the relevant standards. This will help to more accurately evaluate building energy performance in hot periods of the year.

Role of public and private sector; new market opportunities

2. Since 2000, the energy consumed by residential space heating in the subregions A and B has decreased, as a percentage of total household consumption, by at least 4%. This development is due to initiatives undertaken by the private sector to develop efficient technologies. European companies have developed and produced more than 90% of the efficient and renewable boilers used in the EU countries.

Recommendation D: *Governments should undertake initiatives to raise the bar for developing energy efficient technologies in buildings locally, which can create new international markets*. In subregions A and B, new technologies, such as fuel cell cogeneration and geothermal heating / cooling, are being developed by European companies. They have no competitors for their innovations, and have found international markets including China, South Korea, and the Middle East. A similar approach can be encouraged by national governments in subregions D, C, E, and F. Currently there is strong support for development and manufacturing of energy efficient technologies, encouraged by various tax incentives and procurement preferences for local companies, in a few counties in subregions C and E. However, most advanced energy efficient technologies are still imported.

Connect building energy efficiency with INDC targets; reduce fossil fuel use in space heating

3. There are several countries in the UNECE region in which coal is still prevalent as a decentralized building heating fuel. Since coal is cheaply and easily available in these countries, modern energy efficient coal-fired boilers are being adopted in both new construction and building retrofits. While energy efficiency is improved, strong concerns remain regarding the health risks of using coal for residential space heating.

Recommendation E: *Governments should explicitly connect building energy efficiency measures to INDC targets to further encourage improvement*. Increasing energy efficiency in the buildings sector will result in a clear reduction in CO_2 emissions from electricity generation, which is related to the Intended Nationally Determined Contributions (INDC) as part of the UNFCCC negotiations. Governments can simultaneously promote energy efficiency in the buildings sector and progress toward climate change reduction goals by connecting building energy efficiency measures with INDC targets.

Recommendation F: *Governments of countries in which coal is still used for residential heating, and coal is the lowest cost fuel, should promote the use of other fuels to drive the adoption of cleaner technologies*. Installation of increased efficiency coal-fired boilers should be encouraged only in the short term as a stop-gap measure.

Informational awareness for multiple social benefits of energy performance certification

4. In subregions A and B, energy performance certificates are mandatory and widely implemented. Buildings throughout the European Union can be rated and certified for their efficient use of energy. In subregion D (United States), buildings may voluntarily obtain LEED certification, which shares similarity with the NZEB codes. Residences with higher ratings tend to earn substantially higher premiums. Building owners are hence able to earn a profit on energy efficiency

Draft

investments from both reduced energy consumption and increased economic rents The countries of subregions C, E, and F have not implemented mandatory building performance certificate program yet.

Recommendation G: *Local governments should publish city-level data demonstrating both decreased energy costs and higher income associated with various levels of energy performance certification to promote building energy efficiency investments*. The major benefits of energy performance certificates have been documented in multiple countries across subregions A, B and D, however for subregions C, E and F more information on this is needed. Local governments can promote increased energy efficiency in buildings associated with EPCs by collecting and publishing data – preferably at the city level – demonstrating both decreased energy costs and higher income from rental or sale.

Technological adaptation through effective promotion and awareness campaigns

5. With the implementation of labelling and eco-design regulations, the uptake of energy efficient appliance is on an upward trend. In subregions A and B, some countries have failed to realize the expected increased energy efficiency in appliances, as there has been insufficient promotion of labelled products. In addition, some appliance labelling schemes have minimum requirements which are equal, or very close, to the market averages. Most countries of subregions C, E, and F have progressed substantially due to the existence of regulations mandating installation of energy efficient appliances - for both new and retrofit buildings. Similarly, lighting control system and smart meters have not widely integrated into building systems though these technologies can have a large impact on reducing energy consumption. Only a few countries from subregions B and D have made moderate use of these technologies.

Recommendation H: *Effective promotion and awareness campaigns are essential to encourage consumers to purchase appliances labelled with high energy efficiency ratings.* In additions, more stringent regulations are needed to promote exterior and interior lighting in non-residential buildings and develop social pricing structures for homeowners to install smart meters and create awareness programs reflecting upon the variety of benefits from adopting this technology.

Key focus on building retrofits

6. Much of the efforts to increase energy efficiency in the buildings sector appear to be focused on new construction. The existing building stock will continue to consume energy inefficiently, leading to waste through inefficient insulation and appliance use. Building retrofits can impact the energy use of existing buildings, and can grow the economy by creating opportunities for other sectors, encourage small and medium enterprises, increase job opportunities, and lead to local content development and R&D. In some countries of subregions A, B, C, and E, measures are being adopted to encourage building retrofit programs with the help of technological tools.

Recommendation I: *Governments should promote the creation of datasets and tools which guide analysis of, and demonstrate, the financial benefits of increasing energy efficiency through retrofitting existing buildings. Specifically, this should include the use of simulation software tools for building energy performance during the design phase of both new building construction and post through major building retrofits.* Governments should promote and sponsor creation of datasets and tools demonstrating potential cost savings that may be realized from various energy efficiency technologies, covering both residential and commercial buildings.

Recommendation J: *Governments should develop and promote programs to encourage complete retrofit of depleted and condemned residences involving private real estate investors or developers*. Multi-family residential buildings with shared ownership which are deemed unfit for occupancy could

Draft

be demolished and rebuilt – or undergo major retrofits – without recourse to public funds. Governments can create programs wherein private real estate investors or developers construct new sustainable buildings or retrofit existing building shells with more residential capacity. The developer guarantees unchanged ownership to current owners and a better living space, while giving investors profit from selling the extra residential capacity.

Coordination between federal and regional governments to reassess development and implementation of building codes

7. In some countries, the governance structure is such that building codes are made at a federal level, while regional governments choose whether to adopt the codes. This is found mostly in countries from subregions C D, and E. This situation hinders the federal government from driving action. Also, the codes should be updated more frequently considering the technological development in the buildings sector.

Recommendation K: *Federal and regional governments need to coordinate and work together to design the policies and building codes which can be adopted either nationally or regionally.* Regulatory bodies should consider implementing performance-based building codes with minimum energy standards rather than prescriptive building codes. This will give building contractors and owners the flexibility to choose the best technological option to reduce energy consumption.

Investment and finance

8. In most UNECE countries, substantial financial barriers to energy efficiency technology adoption in households remain for both new buildings and retrofits. Several countries are facing challenges to support incentive schemes encouraging increased building retrofits.

Recommendation L: *Governments should develop and promote multiple financial mechanisms to increase the uptake of energy efficiency projects across the buildings sector: individual, public and commercial.* Financing options to support the energy efficiency transition across the buildings sector could include: establishing national and regional public finance mechanisms (loans, grants), making reduced-rate financing available by banks, local authorities, and private financiers to support adoption of energy efficiency measures by individuals, project finance options by banks, institutional and other private investors for public and commercial building owners, and carbon credits and renewable obligation certificates for utilities companies. To help overcome the complexity of investments and lack of capacity at the individual and suppliers' level, Energy Service Companies (ESCO) should be more heavily promoted by Governments.

Capacity building to promote building retrofits

9. The analysis undertaken in this study shows that much of the effort to increase energy efficiency in the buildings sector is focused on new construction across the UNECE region.

Recommendation M: *Courses and programs focused on renovation of existing buildings should be made part of standard civil engineering educational and training curricula*. Energy efficiency and renovations are essential elements of building lifecycle management, a discipline that has so far been largely neglected in education, in favour of courses focusing on new development. Courses are needed for both young people and mature students, and for both new recruits and professionals. By focusing more on renovation of existing buildings, countries can obtain varied social benefits; one of which is increased jobs in small- and medium-sized enterprises.

Recommendation N: *Financial institutions should be empowered to understand profitability of energy efficiency investments*. Increased activities of international financial institutions on energy efficiency

Draft

projects influence local investment markets and support the growing interest of local banks and other financial institutions in energy efficiency lending and project financing. However, there is still a gap in financial professionals' technical competence, limiting their understanding of the multiple benefits of energy efficiency investments. Some governments provide financial tools for the evaluation of energy efficiency investments, to promote financing. Better promotion and dissemination of best practices, appropriate de-risking, and financing solutions for banking specialists is required. Clear technical and financial criteria should be defined by the financial institutions to grant loans. Additionally, a pre-approved list of eligible equipment manufacturers and suppliers, can assist in measuring and avoiding risks.

Expanded use of Energy Performance Certificates

10. Energy performance certificates are in use in many countries. They are, however, currently used predominantly only for informational purposes. EPCs could be used to in additional ways to provide more value to building owners and further encourage energy efficiency investments.

Recommendation O: *Governments could create tiered energy tariffs linked to EPC rating.* Buildings with higher EPC ratings use energy less and / or more efficiently, and hence owners are directly compensated for the investment. This benefit could be magnified if higher-rated buildings also received lower energy tariffs. Such an EPC-based tiered pricing program could both encourage energy performance certification and the implementation of energy efficiency technologies.

Recommendation P: *Incentives for implementing energy efficiency technologies could be linked to EPC rating*. Many countries in the UNECE region implement energy performance certification and energy efficiency technology investment incentives separately. In the majority of cases, incentives are related to the implementation of a single specified technology. A more holistic program would provide incentives proportional to the EPC rating of a building, and projected improvement (similar to performance-based building standards). For example, consider a C-rated building that is retrofit such that it afterwards is rated A. This should result in a higher rebate, higher land use tax compensation, or lower debt interest rate, as compared to an upgrade from C to B. There are only a few cases of incentives linked directly to EPC rating.

Future scope of study

The scope of this study limits evaluation of the costs vis-à-vis benefits of energy efficiency technologies, and analysis of how these correlates to the adoption of technologies in the buildings sector. A future follow-up study assessing and analysing the potential energy savings associated with implementation of specific technologies into new and/or existing buildings for the UNECE regions could be valuable.

Draft

References

Draft